

Terraprobe

*Consulting Geotechnical & Environmental Engineering
Construction Materials Inspection & Testing*

**GEOTECHNICAL INVESTIGATION
PROPOSED RESIDENTIAL REDEVELOPMENT
1840-1850 BLOOR STREET
MISSISSAUGA, ONTARIO**

Prepared for: Ranee Management
4122 Bathurst Street
North York, Ontario
M3H 3P2

Attention: Ms. Ilana Glickman

©Terraprobe Inc.

File No. 1-19-0720-01

Issued: February 25, 2020

Distribution

1 Electronic Copy - Ranee Management
3 Copies - Ranee Management
1 Copy - Terraprobe Inc., Brampton

Terraprobe Inc.

Greater Toronto

11 Indell Lane
Brampton, Ontario L6T 3Y3
(905) 796-2650 Fax: 796-2250
brampton@terraprobe.ca

Hamilton – Niagara

903 Barton Street, Unit 22
Stoney Creek, Ontario L8E 5P5
(905) 643-7560 Fax: 643-7559
stoneycreek@terraprobe.ca

Central Ontario

220 Bayview Drive, Unit 25
Barrie, Ontario L4N 4Y8
(705) 739-8355 Fax: 739-8369
barrie@terraprobe.ca

Northern Ontario

1012 Kelly Lake Rd., Unit 1
Sudbury, Ontario P3E 5P4
(705) 670-0460 Fax: 670-0558
sudbury@terraprobe.ca

www.terraprobe.ca

TABLE OF CONTENTS

1	INTRODUCTION	1
2	SITE AND PROJECT DESCRIPTIONS	1
3	INVESTIGATION PROCEDURE	2
4	SUBSURFACE CONDITIONS	3
	4.1 Fill.....	3
	4.2 Silty Sand	3
	4.3 Glacial Till.....	4
	4.4 Inferred Bedrock.....	4
	4.5 Geotechnical Laboratory Test Results	4
	4.6 Groundwater.....	5
5	DISCUSSIONS AND RECOMMENDATIONS	6
	5.1 Foundation	6
	5.1.1 Foundation Installation.....	7
	5.2 Basement Floor Slab	7
	5.3 Lateral Earth Pressure Design Parameters.....	8
	5.4 Earthquake Design Parameters.....	9
	5.5 Basement Drainage	10
	5.6 Excavations	11
	5.7 Groundwater Control	12
	5.7.1 Regulatory Requirements	13
	5.8 Pipe Bedding and Cover/Embedment.....	14
	5.9 Backfill.....	14
	5.10 Pavement	15
	5.10.1 Pavement Design.....	15
	5.10.2 Drainage	16
	5.10.3 Subgrade Preparation.....	16
	5.11 Sulphate Attack	17
	5.12 Shoring Design Consideration	17
	5.12.1 Earth Pressure Distribution	18
	5.12.2 Soldier Pile Toe Design.....	19
	5.12.3 Shoring Support.....	19
	5.13 Quality Control.....	20
6	LIMITATIONS AND RISK	21
	6.1 Procedures	21
	6.2 Changes in Site and Scope	21

ENCLOSURES

Figures

- Figure 1 Site Location Plan
- Figure 2 Borehole Location Plan

Appendices

- Appendix A Borehole Logs
- Appendix B Geotechnical Laboratory Test Results
- Appendix C Certificate of Analysis
- Appendix D Typical Basement Wall Drainage Schematic and Basement Floor Subdrain Detail



1 INTRODUCTION

Terraprobe Inc. (Terraprobe) was retained by Ranee Management to conduct a geotechnical investigation for a proposed residential redevelopment at 1840-1850 Bloor Street, Mississauga, Ontario.

This report encompasses the results of the geotechnical investigation conducted for the proposed redevelopment to determine the prevailing subsurface soil and groundwater conditions, and on this basis, provides geotechnical design advice and engineering recommendations for the design of foundations, basement floor slab, basement drainage, pavement design, seismic site class, and lateral earth pressure design parameters. Geotechnical comments are also included on pertinent construction aspects, excavation, bedding/embedment, backfill and groundwater control.

Terraprobe has also conducted a Hydrogeological Study for this project. The findings of the investigation are reported under separate cover.

2 SITE AND PROJECT DESCRIPTIONS

The project site is located on the south side of Bloor Street, at the intersection of Bloor Street and Bridgewood Drive in the City of Mississauga, Ontario. The general location of the site is presented in Figure 1 – Site Location Plan.

The site is a trapezoidal parcel of land with a total area of approximately 39,300 m² (9.7 acres). The site is an active apartment complex that comprises two 14-storey residential towers with municipal addresses of 1840 and 1850 Bloor Street with an outdoor swimming pool, a basketball court, asphalt-paved parking lots, and landscaped area. Both towers have one level of underground parking that extends beyond the above-ground footprint of the respective towers. The two existing towers and their underground parking structures occupy approximately the northern half of the site. The outdoor swimming pool, basketball court, and landscaped area occupy approximately the southern half of the site.

Based on the preliminary architectural drawings titled “Pre-Consultation Meeting”, prepared by IBI Group Architects (Canada) Inc. (IBI), the proposed construction will consist of demolition of the outdoor swimming pool and basketball court to facilitate the construction of two new 18-storey residential towers on top of a 4-storey L-shaped podium in the southern half of the site. One level of L-shaped underground parking garage will be constructed beneath the podium. New circular at-grade driveway, outdoor amenity, and new landscaped area will be constructed within the central area surrounded by four towers (two new and two existing). The approximate locations of the two existing residential towers, the proposed two new residential towers and the limit of the new basement are shown in the attached Figure 2 – Borehole Location Plan.

According to the site topographic survey, dated May 22, 2019, prepared by Speight, Van Nostrand & Gibson Limited, the topography of the southern half of the site slopes gentle down from northwest at about elevation (El.) 129.5 m to southeast of the site at about El. 127.5 m. Although the elevation of the

top of finished basement floor is not shown in the IBI drawings at the time of the issuance of this report, we assume the top of basement floor will be at about 3.5 m below existing grade (mbg) and the foundation level will be at about 4.5 mbg (about El. 125.0 m).

3 INVESTIGATION PROCEDURE

The field investigation was conducted on November 27 through 29, 2019, and consisted of drilling and sampling a total of eight (8) boreholes, denoted as BH1 through BH8, extending to about 5.7 to 6.3 mbg. The approximate locations of the boreholes are shown on the enclosed Figure 2 - Borehole Location Plan.

The boreholes were drilled by a specialist drilling contractor using track-mounted drill rig with rubber tires. The boreholes were advanced using continuous flight solid and hollow stem augers, and were sampled at 0.75 or 1.5 m intervals with a conventional 50-mm-diameter split barrel sampler when the Standard Penetration Test (SPT) was carried out (ASTM D1586). The field work (drilling, sampling and testing) was observed and recorded by a member of our field engineering staff, who logged the borings and examined the samples as they were obtained.

All samples obtained during the investigation were sealed into clean plastic jars, and transported to our geotechnical testing laboratory for detailed inspection and testing. All borehole samples were examined (tactile) in detail by a geotechnical engineer, and classified according to visual and index properties. Laboratory tests consisted of water content determination on all samples and a Sieve and Hydrometer analysis on selected native soil samples; and Atterberg Limits tests on one selected cohesive soil sample. The measured natural moisture contents of individual samples and the results of the Sieve and Hydrometer analysis and Atterberg Limits tests are plotted on the enclosed Borehole Logs at respective sampling depths. The results of Sieve and Hydrometer analyses and Atterberg Limits tests are also summarized in Section 4.5 of this report, and attached herein as Appendix A – Borehole Logs and Appendix B – Geotechnical Laboratory Test Results.

Three (3) samples of soil (Borehole 2, Sample 6; Borehole 6, Sample 5; and Borehole 8, Sample 6) were selected and tested for a suite of corrosivity parameters consisting of pH, Resistivity, Electrical Conductivity, Redox Potential, Sulphate, Sulphide, and Chloride. The results of soil corrosivity analyses are summarized in Section 5.11 of this report and a copy of the Certificates of Analyses is included in Appendix C.

Groundwater levels were measured in open boreholes upon completion of drilling. Monitoring wells comprising 50-mm-diameter PVC pipes were installed in selected boreholes (Boreholes 1, 4 and 8) to facilitate groundwater monitoring. The PVC piping was fitted with a bentonite clay seal as shown on the accompanying Borehole Logs. Groundwater levels in the monitoring wells were measured on December 10, 16 and 23 2019 and January 9, 2020, about 11 days, 17 days, 24 days, and 41 days, respectively, following the installation. The results of groundwater monitoring are presented in Section 4.6 of this report.

The borehole ground surface elevations and the coordinates (Universal Transverse Mercator, UTM, Zone 17T) were surveyed by Terraprobe using a Trimble R10® GNSS System. The Trimble R10® system uses the Global Navigation Satellite System and the Can-Net® reference system to determine target location and elevation. The Trimble R10® system is reported to have an accuracy of up to 10 mm horizontally and up to 30 mm vertically.

It should be noted that the elevations provided on the Borehole Logs are approximate only, for the purpose of relating soil stratigraphy and should not be used or relied on for other purposes.

4 SUBSURFACE CONDITIONS

The specific soil conditions encountered at each borehole location are described in greater detail on the Borehole Logs, with a summary of the general subsurface soil conditions outlined below. This summary is intended to correlate this data to assist in the interpretation of the subsurface conditions encountered at the site.

It should be noted that the subsurface conditions are confirmed at the borehole locations only, and may vary between and beyond the borehole locations. The boundaries between the various strata as shown on the logs are based on non-continuous sampling. These boundaries represent an inferred transition between the various strata, rather than a precise plane of geologic change.

4.1 Fill

Below the 140- to 160-mm topsoil at all boreholes, brown to dark brown miscellaneous fill material consisting of clayey to sandy silt with trace amounts of gravel and organic matters were encountered in all eight boreholes. This fill layer extended to depths ranging from about 0.6 mbg at Boreholes 3 and 4 to about 3.0 mbg at Borehole 2.

Standard Penetration Test results (N-values) obtained from the earth fill zone ranged from 5 to 18 blows per 300 mm of penetration (blows per foot, bpf), indicating firm to very stiff consistency (cohesive soils) or loose to compact relative density (cohesionless soils). The moisture contents of the fill samples ranged from 8 to 20%, indicating a moist condition.

4.2 Silty Sand

Brown silty sand with trace amount of gravel was encountered below the fill material in Borehole 1. This silty sand layer extended to the depth of about 3.0 mbg at Borehole 1.

N-value obtained from the undisturbed silty sand deposit was 17 bpf, indicating a compact compactness. The moisture content of the native soil sample was 14%, indicating a wet condition.

4.3 Glacial Till

Undisturbed native glacial till material consisting of clayey to sandy silt with various amount of sand and gravel (some sand and trace gravel) was encountered below the fill material and extended to the depths of about 4.6 mbg in Boreholes 1 through 4 and about 6.0 mbg in Boreholes 5 through 8.

N-values obtained from the till layer ranged from 12 bpf to 50 blows per 75 mm of penetration, indicating soft to hard consistency. The moisture contents of the till samples ranged from 4 to 18%, indicating damp to wet conditions.

4.4 Inferred Bedrock

Grey weathered shale bedrock fragments were encountered below the sand and gravel layer in Borehole 2, below the sandy silt layer in Borehole 4, and below the glacial till in Boreholes 1, 3, and 5 through 8 to the termination depths of all boreholes.

The inferred bedrock beneath the site is expected to be of the Georgian Bay Formation, which is a deposit predominantly comprised of thin- to medium-bedded grey shale of Ordovician age. The shale contains interbedded grey calcareous shale, limestone/dolostone and calcareous sandstone (conventionally grouped together as “limestone”) which are discontinuous and nominally 25 to 125 mm thick.

The augered borehole method used at this site is conventionally accepted investigative practice. However, the interval sampling method does not define the bedrock surface with precision, particularly where the surface of the rock is weathered, weaker and easily penetrated by auger. The auger refusal is generally indicative of a presence of a relatively less weathered/sound shale and/or limestone/dolostone layers. It should be noted that confirmation and characterization of the bedrock through rock coring was not included in our scope of work. Therefore, the bedrock surface elevations at the borehole locations, as noted on the borehole logs, could not be confirmed, and were inferred from the borehole augering, auger grinding, split barrel sampler refusal and bouncing. Auger grinding or sampler refusal in this case could either be inferred as bedrock or could be due to the presence of boulders/obstruction/limestone slabs which may be present within the overburden, therefore actual bedrock surface elevations may vary from the inferred elevations noted on the borehole logs. It must be noted that inference of bedrock level based on auger grinding and/or sampler refusal does not provide bedrock level accurately.

4.5 Geotechnical Laboratory Test Results

The geotechnical laboratory testing consisted of natural moisture content determination for all samples, while Sieve and Hydrometer analysis and Atterberg Limits tests were conducted on selected soil samples. The test results are plotted on the enclosed Borehole Logs at respective sampling depths.

The results (graphs) of the Sieve and Hydrometer (grain size) analysis are appended and a summary of these results is presented as follow:

Borehole No. Sample No.	Sampling Depth below Grade (m)	Percentage (by mass)				Descriptions (MIT System)
		Gravel	Sand	Silt	Clay	
2, Sample 5	3.3	2	44	43	11	SILT AND SAND some clay, trace gravel (TILL)
3, Sample 6	4.8	20	42	24	14	SILTY SAND some gravel, some clay (TILL)
6, Sample 3	1.8	0	7	59	34	CLAYEY SILT trace sand
8, Sample 6	4.8	14	30	39	17	SANDY SILT some clay, some gravel (TILL)

Atterberg Limits Test was carried out on one selected soil sample. The results were plotted on A-Line Graph (refer to enclosed Figure, Atterberg Limits Test Results) and summarized as follows:

Borehole No. Sample No.	Sampling Depth below Grade (m)	Liquid Limit (W _L)	Plastic Limit (W _P)	Plasticity Index (I _P)	Natural Moisture Content (%)	Plasticity
3, Sample 6	4.8	19	12	7	7	Slightly Plastic

4.6 Groundwater

Observations pertaining to the depth of groundwater level and caving were made in the open boreholes immediately after completion of drilling, and are noted on the enclosed Borehole Logs. Monitoring well was installed in Boreholes 1, 4 and 8 to facilitate groundwater level monitoring and the purpose of hydrogeological study. The groundwater level measurements in the monitoring wells were taken on December 10, 16 and 23 2019 and January 9, 2020, about 11 days, 17 days, 24 days, and 41 days, respectively, following the installation and they are noted on the enclosed Borehole Logs. A summary of these observations is provided as follows:

Borehole No.	Ground Surface Elevation (m)	Depth of Boring below Grade (m)	Depth to Cave below Grade (m)	Groundwater Level Depth/Elevation (m)				
				at the Time of Drilling	in Monitoring Wells on Dec 10, 2019	in Monitoring Wells on Dec 16, 2019	in Monitoring Wells on Dec 23, 2019	in Monitoring Wells on Jan 9, 2020
1	128.8	5.9	Open	Dry	1.4 / 127.4	1.6 / 127.2	1.3 / 127.5	1.7 / 127.1
4	127.9	5.7	Open	Dry	0.5 / 127.4	0.4 / 127.5	0.6 / 127.3	0.6 / 127.3
8	128.6	6.3	Open	Dry	3.3 / 125.3	1.9 / 126.7	1.6 / 127.0	2.0 / 126.6

The water levels noted above may fluctuate seasonally depending upon the amount of precipitation and surface runoff.

5 DISCUSSIONS AND RECOMMENDATIONS

The following discussion and recommendations are based on the factual data obtained from this investigation and are intended for the use of the owner and the design engineer. Contractors bidding or providing services on this project should review the factual data and determine their own conclusions regarding construction methods and scheduling.

This report is provided on the basis of these terms of reference and on the assumption that the design features relevant to the geotechnical analyses will be in accordance with applicable codes, standards and guidelines of practice. If there are any changes to the site development features or there is any additional information relevant to the interpretations made of the subsurface information with respect to the geotechnical analyses or other recommendations, then Terraprobe should be retained to review the implications of these changes with respect to the contents of this report.

5.1 Foundation

The boreholes encountered the topsoil layer at the ground surface underlain by clayey silt and sandy silt fill material extending to depths ranging from 0.6 to 3.0 mbg, which was in turn underlain by undisturbed native soil deposits and/or inferred bedrock, extending to the full depth of the investigation.

According to IBI's preliminary architectural drawings, the proposed development will include two 18-storey residential towers with one common underground parking garage. Although the elevation of the top of finished basement floor is not shown in the IBI drawings at the time of the issuance of this report, we assume the top of basement floor will be at about 3.5 mbg and the foundation level will be at about 4.5 mbg (about El. 125.0 m±).

Based on the findings from the subsurface investigation, glacial till material was encountered at about El. 125.0 m in all boreholes and undisturbed glacial till is considered suitable material to support the proposed structure foundations. We recommend the proposed structure should bear on the glacial till material at about El. 125.0 m (or lower). A maximum net geotechnical reaction at Serviceability Limit States (SLS) of 400 kPa and a maximum factored geotechnical bearing resistance at Ultimate Limit States (ULS) of 600 kPa are recommended for design of conventional spread footing foundations (for vertical and concentric loads) supported on the underlying competent undisturbed glacial till material. The geotechnical resistance(s) as recommended allow for up to 25 mm of total settlement. This settlement will occur as load is applied and is linear elastic and non-recoverable. Differential settlement is a function of spacing, loading and foundation size.

Higher bearing pressures are also available and can be analyzed in detail based on the final building design. The final grading plan and design drawings should be reviewed by Terraprobe to better assess the design foundation elevations and to provide updated foundation bearing pressure (geotechnical reaction and resistance) recommendations prior to the development.

The underside of footing elevations must be designed to provide a minimum of 1.2 m of soil cover or equivalent insulation to the foundation subgrade for frost protection considerations in unheated areas. All footings must be designed to bear at least 0.3 m into the undisturbed native soil stratum.

5.1.1 Foundation Installation

All exterior foundations and foundations in unheated areas must be provided with a minimum soil cover of 1.2 m or equivalent insulation for frost protection.

It is recommended that all excavated footing base must be evaluated by a qualified geotechnical engineer to ensure that the founding soils exposed at the excavation base are consistent with the design bearing pressure intended by the geotechnical engineer.

Prior to pouring foundation concrete, the foundation subgrade should be cleaned of all deleterious materials such as topsoil, fill, softened, disturbed or caved materials, as well as any standing water. If construction proceeds during freezing weather conditions, adequate temporary frost protection for the foundation subgrade and concrete must be provided.

It is noted that the native soils tend to weather rapidly and deteriorate on exposure to the atmosphere or surface water. Hence, foundation bases which remain open for an extended period of time should be protected by a skim coat of lean concrete (mud slab). Provisions should be made to minimize disturbance to the exposed foundation subgrade.

5.2 Basement Floor Slab

Fill material encountered at the basement floor subgrade shall be removed. The modulus of subgrade reaction appropriate for the slab design constructed on undisturbed glacial till subgrade is 30,000 kPa/m. The excavated surface should be assessed by a qualified geotechnical engineer.

The basement floor slab should be provided with a capillary moisture barrier and drainage layer. This can be made by placing the slab on a minimum 150 mm thick 19 mm clear stone layer (OPSS.MUNI 1004) compacted by vibration to a dense state. This material also serves as the drainage media for the subfloor drainage system. Provision of subfloor drainage with spacing at maximum 5 m on-centres is required in conjunction with the perimeter drainage of the structure (refer to Appendix D for typical basement wall drainage details).

The subfloor drainage system is an important building element, as such the storm sump which ensures the performance of this system must have a duplexed pump arrangement for 100% pumping redundancy and this pump must be provided with emergency power as needed. Basement walls (open-excavation or one-sided wall constructions) and subfloor drainage provisions are further discussed in Section 5.5 of this report.

5.3 Lateral Earth Pressure Design Parameters

Walls or bracings subject to unbalanced earth pressures must be designed to resist a pressure that can be calculated based on the following equation:

$$P = K [\gamma (h-h_w) + \gamma' h_w + q] + \gamma_w h_w$$

Where:

P	=	the horizontal pressure (kPa)
K	=	the earth pressure coefficient
h	=	the depth below the ground surface (m)
h_w	=	the depth below the groundwater level (m)
γ	=	the bulk unit weight of soil (kN/m ³)
γ_w	=	the bulk unit weight of water (9.8 kN/m ³)
γ'	=	the submerged unit weight of the exterior soil, (γ _{sat} - γ _w)
q	=	the complete surcharge loading (kPa)

Where the wall backfill can be drained effectively to eliminate hydrostatic pressures on the wall, this equation can be simplified to:

$$P = K[\gamma h + q]$$

This equation assumes that free-draining granular backfill is used and positive drainage is provided to ensure that there is no hydrostatic pressure acting in conjunction with the earth pressure.

Resistance to sliding of retaining structures is developed by friction between the base of the footing and the soil. This friction (**R**) depends on the normal load on the soil contact (**N**) and the frictional resistance of the soil (**tan φ**) expressed as **R = N tan φ**. The factored geotechnical resistance at ULS is **0.8 R**.

Passive earth pressure resistance is generally not considered as a resisting force against sliding for conventional retaining structure design because a structure must deflect significantly to develop the full passive resistance.

The average values for use in the design of structures subject to unbalanced earth pressures at this site are tabulated as follow:

<u>Parameter</u>	<u>Definition</u>	<u>Units</u>
φ	angle of internal friction	degrees
γ	bulk unit weight of soil	kN/ m ³
K _a	active earth pressure coefficient (Rankine)	dimensionless
K _o	at-rest earth pressure coefficient (Rankine)	dimensionless
K _p	passive earth pressure coefficient (Rankine)	dimensionless

Stratum/Parameter	Φ (degree)	γ (kN/m ³)	K_a	K_o	K_p
Fill	28	19.0	0.36	0.53	2.77
Glacial Till	32	21.0	0.31	0.47	3.25
Compacted Granular Material	32	21.0	0.31	0.47	3.25

The above values of the earth pressure coefficients are for the horizontal backfill grade behind the wall. The earth pressure coefficients for inclined grade will vary based on the inclination of the retained ground surface.

5.4 Earthquake Design Parameters

The Ontario Building Code stipulates the methodology for earthquake design analysis, as set out in Subsection 4.1.8.7. The determination of the type of analysis is predicated on the importance of the structure, the spectral response acceleration and the site classification.

The parameters for determination of Site Classification for Seismic Site Response are set out in Table 4.1.8.4.A. of the Ontario Building Code. The classification is based on the determination of the average shear wave velocity in the top 30 m of the site stratigraphy, where shear wave velocity (v_s) measurements have been taken. Alternatively, the classification is estimated on the basis of rational analysis of undrained shear strength (s_u) or penetration resistance (N-values).

$$v_{s-avg} = \frac{\sum_{i=1}^n d_i}{\sum_{i=1}^n \frac{d_i}{v_{si}}} \qquad S_{u-avg} = \frac{\sum_{i=1}^n d_i}{\sum_{i=1}^n \frac{d_i}{s_{ui}}} \qquad N_{avg} = \frac{\sum_{i=1}^n d_i}{\sum_{i=1}^n \frac{d_i}{N_i}}$$

Shear Wave Velocity
Undrained Shear Strength
SPT N-values

Based on the borehole data (advanced to a maximum of 6.3 mbg), it is understood that the proposed structure will be founded on the native glacial till. It is expected that the deeper stratigraphy in this area is at least as competent as the lowest proven strata in the boreholes. On this basis, preliminary site seismic classification may be taken as Site Class C according to Table 4.1.8.4.A of the Ontario Building Code (2012). Tables 4.1.8.4.B. and 4.1.8.4.C. of the Ontario Building Code (2012) provide the applicable acceleration and velocity based site coefficients. The applicable acceleration and velocity based site coefficients for Site Class C are provided as follows:

Site Class	Values of F_a (acceleration based coefficients)				
	$S_a(0.2) \leq 0.25$	$S_a(0.2) = 0.50$	$S_a(0.2) = 0.75$	$S_a(0.2) = 1.00$	$S_a(0.2) \geq 1.25$
C	1.0	1.0	1.0	1.0	1.0

Site Class	Values of F_v (velocity based coefficients)				
	$S_a(1.0) \leq 0.1$	$S_a(1.0) = 0.2$	$S_a(1.0) = 0.3$	$S_a(1.0) = 0.4$	$S_a(1.0) \geq 0.5$
C	1.0	1.0	1.0	1.0	1.0

It should be noted that the above site seismic designation is estimated on the basis of rational analysis of the corrected SPT N-Values information obtained from the boreholes advanced at the site up to a maximum of 6.3 m below grade.

5.5 Basement Drainage

The groundwater levels measured on December 10, 16 and 23, 2019 and January 9, 2020 in the monitoring wells installed in Boreholes 1, 4 and 8 indicated that the groundwater levels ranged from about 0.4 to 3.3 mbg (about El. 127.5 m to El. 125.3 m).

To assist in maintaining basement dry from seepage, it is recommended that exterior grades around the new building be sloped away at a 2% gradient or more, for a distance of at least 1.2 m.

In case the basement walls are constructed within an open excavation, perimeter foundation drains should be provided, consisting of perforated pipe with filter fabric (minimum 100 mm diameter) surrounded by a granular filter (minimum 150 mm thick), and freely outletting. The granular filter should consist of 19 mm clear stone (OPSS.MUNI 1004) surrounded by a filter fabric (Terrafix 270R® or equivalent).

The basement wall must be provided with damp-proofing provisions in conformance to the Section 9.13.2 of the Ontario Building Code. The basement wall backfill for a minimum lateral distance of 0.6 m out from the wall should consist of free-draining granular material (OPSS.MUNI 1010 Granular B), or provided with a prefabricated drain material (for instance, CCW MiraDRAIN 6000 series®, Terrafix Terradrain 600® or equivalent), see Appendix D for typical basement wall (open excavation) drainage details. The perimeter drain installation and outlet provisions must conform to the plumbing code requirements.

If the foundation walls are constructed against the shoring system (one-sided wall construction), drainage is provided by forming a drained cavity with prefabricated drain material, such as CCW MiraDRAIN 6000 series® (or Terrafix Terradrain 200®, or approved equivalent) which can be incorporated between the shoring and the cast-in-place concrete foundation wall. The drainage composite material can be outlet

into the basement sumps using a solid pipe (separate from the subfloor drainage system) to remove collected water at the building sumps. See Appendix D for typical basement wall (one-sided wall construction) drainage details.

A subfloor drainage system is recommended. The sub-floor drainage system should consist of perforated pipes (minimum 100 mm diameter) located at a maximum spacing of 5.0 m centre-to-centre (Appendix D for typical basement wall drainage details and basement subdrain detail). The subdrain system should be outlet to a suitable discharge point under gravity flow, or connected to a sump located in the lowest level of the basement. The water from the sump must be pumped out to a suitable discharge point/positive outlet. The installation of the drains as well as the outlet must conform to the applicable plumbing code requirements.

The size of the sump should be adequate to accommodate the water seepage. The sub-floor drainage system should be designed to prevent the possibility of back-flow. A duplex pumping arrangement (main pump with a provision of a backup pump) on emergency backup power is recommended. The pump should have sufficient capacity to accommodate a maximum peak flow of water of about 6 to 8 gallons per minute. This flow is not anticipated to be a sustained flow, but could be achieved under certain peak flow conditions.

5.6 Excavations

The boreholes data indicate that the earth fill/weathered/disturbed materials and undisturbed native soils would be encountered in the excavations. Excavations must be carried out in accordance with the *Occupational Health and Safety Act and Regulations for Construction Projects*. These regulations designate four (4) broad classifications of soils to stipulate appropriate measures for excavation safety.

TYPE 1 SOIL

- a. is hard, very dense and only able to be penetrated with difficulty by a small sharp object;
- b. has a low natural moisture content and a high degree of internal strength;
- c. has no signs of water seepage; and
- d. can be excavated only by mechanical equipment.

TYPE 2 SOIL

- a. is very stiff, dense and can be penetrated with moderate difficulty by a small sharp object;
- b. has a low to medium natural moisture content and a medium degree of internal strength; and
- c. has a damp appearance after it is excavated.

TYPE 3 SOIL

- a. is stiff to firm and compact to loose in consistency or is previously-excavated soil;
- b. exhibits signs of surface cracking;
- c. exhibits signs of water seepage;
- d. if it is dry, may run easily into a well-defined conical pile; and
- e. has a low degree of internal strength

TYPE 4 SOIL

- a. is soft to very soft and very loose in consistency, very sensitive and upon disturbance is significantly reduced in natural strength;
- b. runs easily or flows, unless it is completely supported before excavating procedures;



- c. has almost no internal strength;
- d. is wet or muddy; and
- e. exerts substantial fluid pressure on its supporting system.

The fill material as well as undisturbed native soil deposit encountered in the boreholes are classified as Type 3 Soil above and Type 4 Soil below the prevailing groundwater level, while glacial till deposit would be classified as Type 2 above and Type 3 below the prevailing groundwater level.

Where workmen must enter excavations advanced deeper than 1.2 m, the trench walls should be suitably sloped and/or braced in accordance with the Ontario Occupational Health and Safety Act (OHSA) and Regulations for Construction Projects. The regulation stipulates the steepest slopes of excavation by soil type as follows:

Soil Type	Base of Slope	Steepest Slope Inclination
1	within 1.2 metres of bottom of trench	1 horizontal to 1 vertical
2	within 1.2 metres of bottom of trench	1 horizontal to 1 vertical
3	from bottom of trench	1 horizontal to 1 vertical
4	from bottom of trench	3 horizontal to 1 vertical

Minimum support system requirements for steeper excavations are stipulated in the Occupational Health and Safety Act and Regulations for Construction Projects, and include provisions for timbering, shoring and moveable trench boxes.

It should be noted that the glacial till deposit may contain larger particles (cobbles and boulders) that are not specifically identified in the Borehole Logs. The size and distribution of such obstructions cannot be predicted with borings, because the borehole sampler size is insufficient to secure representative samples of the particles of this size. Provision should be made in excavation contracts to allocate risks associated with time spent and equipment utilized to remove or penetrate such obstructions when encountered.

5.7 Groundwater Control

The groundwater levels measured on December 10, 16 and 23 2019 and January 9, 2020 in the monitoring wells installed in Boreholes 1, 4 and 8 indicated that the groundwater levels ranged from about 0.4 to 3.3 mbg (about El. 127.5 m to El. 125.3 m).

It is anticipated that groundwater seepage will be encountered during the excavation of the basement emanating from wet silt/sand lenses present within the native soil deposit. The groundwater seepage emanating from above the static groundwater table should diminish slowly and can be controlled by continuous pumping from filtered sumps at the base of the excavation. The amount of perched water seepage is expected to increase with the depth of excavation. The glacial till consists of relative low

permeability material, which should preclude significant amounts of free flowing groundwater seepage into the excavation in the short-term.

For excavations extending through the wet permeable silt/sand layers and below the prevailing groundwater level, it will be necessary to lower the groundwater level and maintain it below the excavation base prior to and during the subsurface construction. In order to avoid loosening and sloughing of the base and sides, consideration should be given to install a skim coat of lean concrete (mud-slab) in conjunction with positive groundwater control to preserve the subgrade integrity to provide support to foundations and utilities, and a working platform, as needed. In general, prior dewatering and groundwater control provisions are required for excavations penetrating about 0.3 m or more into the groundwater table in cohesionless soils. Pumping from the sumps, in general may be effective for shallow excavations, up to about 1.0 m below the groundwater level.

It must be noted that without positive groundwater control, the soil would lose its integrity to support foundations.

5.7.1 Regulatory Requirements

The volume of water entering the excavation will be based on both groundwater infiltration and precipitation events. Based on recent regulation changes within O.Reg. 63/16, the following dewatering limits and requirements are as follows:

- Construction Dewatering less than 50,000 L/day: The takings of both groundwater and storm water **does not require** a Construction Dewatering Assessment Report (CDAR) and **does not require** a Permit to Take Water (PTTW) from the Ministry of the Environment, Conservation and Parks (MECP).
- Construction Dewatering greater than 50,000 L/day and less than 400,000 L/day: The taking of groundwater and/or storm water **requires** a Construction Dewatering Assessment Report (CDAR) and **does not** require a Permit to Take Water (PTTW) from the Ministry of the Environment, Conservation and Parks (MECP).
- Construction Dewatering greater than 400,000 L/day: The taking of groundwater and/or storm water **requires** a Construction Dewatering Assessment Report (CDAR) and **requires** a Permit to Take Water (PTTW) from the Ministry of the Environment, Conservation and Parks (MECP).

If it is expected that greater than 50,000 L/day of water will be pumped, a CDAR and/or a PTTW should be obtained as soon as possible in advance of construction to avoid possible delays. Depending on the construction methodology for the site servicing (trench boxes or open cut, and length of trench) and the time of year (high versus low groundwater levels), there is the possibility that water taking of greater than 50,000 L/day may occur at this site.

A CDAR takes up to 1 month to complete if monitoring wells are already installed on site. Once the CDAR is completed, it is uploaded to the Environmental Activity and Sector Registry (EASR), which registers the construction dewatering with the MECP without the need for a permit. If the results of the CDAR indicate that greater than 400,000 L/day will be pumped, a PTTW application must be submitted to the MECP. A PTTW application can take up to an additional 3 months for the MECP to process upon completion of the CDAR. Note that Environmental Compliance Assessments, Impact Study Reports and applicable municipal, provincial and conservation authority approvals (completed by others) will be required as part of the CDAR.

5.8 Pipe Bedding and Cover/Embedment

The design information of the underground services was not available at the time of preparation of this report. The following subsections provide preliminary geotechnical engineering information for the design of underground services with relatively shallow inverts. Trench excavation should be carried out in accordance with the *Occupational Health and Safety Act (OHSA) and Regulations for Construction Projects* (O.Reg. 213/91 with recent amendments), while trench bedding, backfilling and compaction should be carried out in accordance with OPSD 802.010, OPSD 802.030, OPSD 802.031, OPSD 802.032 and /or OPSS MUNI 401, as appropriate.

The undisturbed native soil or shale bedrock, encountered will be suitable for support of buried services that are properly bedded. Where disturbance of the trench base has occurred, due to groundwater seepage, or construction traffic, the disturbed soils should be sub-excavated and replaced with suitably compacted granular material. Any accumulation of water at the base of the excavation and any soft/loose soils should be removed prior to placement of the pipe bedding/embankment. Placement of the pipe bedding/embedment must be done in dry condition.

Concrete pipe should be installed in conformance with the OPSD 802.030, OPSD 802.031, OPSD 802.032 or OPSD 802.033 requirements, as appropriate, while PVC or HDPE pipe should be installed in conformance with the OPSD 802.010 or OPSD 802.013 requirements, as appropriate. The bedding and embedment material includes OPSS.MUNI 1010 Granular A while the cover material for rigid pipes include OPSS.MUNI 1010 Granular B with 100% passing 26.5 mm sieve. Further detail information on bedding/embedment and cover materials can be provided at the detailed design phase.

The bedding, embedment and cover materials should be placed in layers not exceeding 200 mm in thickness and compacted to a minimum of 95% Standard Proctor Maximum Dry Density (SPMDD) or vibrated into a dense state in the case of clear stone type bedding.

5.9 Backfill

The native soils are considered suitable for backfill provided the moisture content of these soils is within 2% of the Optimum Moisture Content (OMC). It should be noted that there may be wet zones within the

subsurface soils (particularly soils excavated from below the prevailing groundwater level) which could be too wet to compact. Any soil material with 3% or higher in-situ moisture content than its OMC, could be put aside to dry or be tilled to reduce the moisture content so that it can be effectively compacted. Alternatively, materials of higher moisture content could be wasted and replaced with imported material which can be readily compacted.

In settlement sensitive areas, the backfill should consist of clean earth and should be placed in lifts of 150 mm thickness or less, and heavily compacted to a minimum of 98% SPMDD at a water content close to optimum (within 2%). The upper 1.2 m of the pavement subgrade must be compacted to a minimum of 100% SPMDD.

It should be noted that the soils encountered on the site are generally not free draining, and will be difficult to handle and compact should they become wetter as a result of inclement weather or seepage. Hence, it can be expected that the earthworks will be difficult and may incur additional costs if carried out during wet periods (i.e. spring and fall) of the year.

5.10 Pavement

It is understood that the paved areas at this site would consist of driveway and parking lot. Design recommendations for pavement structure are provided in this section.

5.10.1 Pavement Design

The asphalt pavement design for the entrance driveway and the parking lot is provided in the following table:

Pavement Structural Layers	Parking Lot		Driveway/Fire Route
	Minimal Design ⁽¹⁾	Performance Design ⁽²⁾	
HMA Surface Course, OPSS 1150 HL 3	40 mm	40 mm	40 mm
HMA Binder Course, OPSS 1150 HL 8	50 mm	50 mm	85 mm
Granular Base Course, OPSS MUNI 1010 Granular A	200 mm	150 mm	200 mm
Granular Subbase Course, OPSS.MUNI 1010 Granular B Type I	not required	300 mm	300 mm
Total Thickness	290 mm	540 mm	625 mm

Notes: (1) A minimal pavement design will provide an estimated service period of about 8 to 10 years
(2) A performance pavement design will provide an estimated service period of about 15 to 20 years

HL 3 and HL 8 hot mix asphalt (HMA) mixes should be designed, produced and placed in conformance with OPSS 1150 and OPSS.MUNI 310 requirements and the relevant City's requirements.

Both the Granular A and Granular B Type I materials should meet the requirements of OPSS.MUNI 1010 requirements and the relevant City's standards. Granular materials should be compacted to 100% of SPMDD.

HL3 HS HMA is recommended as padding. Padding should be placed in lifts not exceeding 50 mm.

Performance graded asphalt cement, PG 58-28, conforming to OPSS.MUNI 1101 requirements, should be used in both HMA binder and surface courses.

A tack coat (SS1) should be applied to all construction joints prior to placing hot mix asphalt to create an adhesive bond. SS1 tack coat should also be applied between hot mix asphalt binder and surface courses.

5.10.2 Drainage

Control of water is an important factor in achieving a good pavement life. The need for adequate subgrade drainage cannot be over-emphasized. The subgrade must be free of depressions and sloped (preferably at a minimum grade of 3%) to provide effective drainage toward subgrade drains. Grading adjacent to the pavement areas should be designed to ensure that water is not allowed to pond adjacent to the outside edges of the pavement.

Continuous pavement subdrains should be provided along both sides of the driveway and drained into respective catchbasins to facilitate drainage of the subgrade and granular materials. Continuous subdrains should be also provided for the parking lot/driveway pavement areas along the curb-lines/sidewalk and at all catchbasins within the parking areas. Two lengths of subdrain (each minimum of about 3 m long) should be installed at each catchbasin. The subdrain invert should be maintained at least 0.3 m below subgrade level. All subdrain arrangements should comply with the City of Mississauga Standard Drawing No. 2220.040.

5.10.3 Subgrade Preparation

All topsoil, organics, soft/loose and otherwise disturbed/weathered soils should be stripped from the subgrade areas. The existing asphaltic concrete should be saw cut and removed. The subgrade is expected to consist of silty sand/sand materials or earth fill material, and these soils will be weakened by construction traffic when wet; especially if site work is carried out during the periods of wet weather. An adequate granular working surface would be likely required in order to minimize subgrade disturbance and protect its integrity in wet periods.

Immediately prior to placing the granular subbase, the exposed subgrade should be compacted and then proof-rolled with a heavy rubber-tired vehicle (such as a loaded gravel truck). The subgrade should be inspected for signs of rutting or displacement. Areas displaying signs of rutting or displacement should be compacted and tested or the material should be excavated and replaced with the Granular B Type I. Backfill material should be placed and compacted to at least 100% of SPMDD. The final subgrade surface should be sloped at a grade of 3% to provide positive subgrade drainage.

5.11 Sulphate Attack

Three (3) samples of soil (Borehole 2, Sample 6; Borehole 6, Sample 5; and Borehole 8, Sample 6) were selected and tested for a suite of corrosivity parameters consisting of pH, Resistivity, Electrical Conductivity, Redox Potential, Sulphate, Sulphide, and Chloride. A copy of the Certificates of Analyses is included in Appendix C.

Concrete material embedded in soil may be subjected to potential sulphate attack depending upon the site specific soil conditions. The test results indicated that the concentration of sulphate in soil ranged from 33 to 140 µg/g (equivalent to 0.0033 to 0.0140% by mass). The analytical results of soluble sulphate concentration were compared to the *Canadian Standard CAN3/CSA A23.1-M94 Table 3, Additional Requirements for Concrete Subjected to Sulphate Attack*. It is anticipated that these results would be used to determine the type of cementing materials to be used to produce concrete for this project. Comparison of the test results indicates that the water-soluble sulphate concentrations in soil are lower than 0.1%. Based on this result, there is a negligible potential for sulphate attack on the concrete, regardless of cementing material used.

5.12 Shoring Design Consideration

Decisions regarding shoring methods and sequencing are the responsibility of the Contractor. Temporary shoring should be carried out by a licensed Professional Engineer experienced in shoring design.

The detailed design of the proposed building was not available at the time of preparation of this report. The sections along the perimeter of the site will likely have to be shored to preserve the integrity of the boundary conditions (adjacent structures and roads). No excavation shall extend below a line cast as one vertical to one horizontal from foundations of the existing structures without adequate alternate support being provided. Where the adjacent building foundations are removed from the excavation, a foundation which lies above a line drawn upward at 10 horizontal to 7 vertical from the closest excavation edge is within the zone of potential influence of the excavation, and support for the existing foundations must be carefully assessed and possibly augmented.

The shoring requirements for the site will have to be examined in detail with respect to the site boundary constraints, once the development details and the building footprint are finalized. Depending upon the boundary conditions and structures located in the vicinity, groundwater condition and dewatering details,

the shoring system may consist of a rigid (interlocking drilled caissons) or a steel soldier piles and timber lagging shoring system, or a combination of both. Based on the subsurface soil conditions (predominantly low permeability cohesive soils) a soldier piles and timber lagging shoring system should suffice for the site except in the area where existing structures are located in the close proximity/zone of influence of the excavation where a caisson wall shoring system will be required to provide support to existing foundations at an at-rest condition.

According to the groundwater levels monitored from December 10, 2019 to January 9, 2020, the groundwater levels within the fill layer ranged from 1.3 to 1.7 mbg (Borehole 1) and from 1.6 to 3.3 mbg (Borehole 8). The highest perched groundwater level throughout the monitoring period is 1.3 mbg at Borehole 1 and therefore, we recommend the groundwater level may be designed to be at 1.5 m below grade (about El. 127.3 m) across the site.

5.12.1 Earth Pressure Distribution

If a single level of support will be required for shoring system, a triangular earth pressure distribution similar to that used for the basement wall design, is appropriate for this case,

Where:

P =	K(γh+ q)
P =	the horizontal pressure (kPa)
K =	the earth pressure coefficient
h =	the depth below the ground surface (m)
γ =	the bulk unit weight of soil (kN/m ³)
q =	the complete surcharge loading (kPa)

Applicable soil parameters are included in the Earth Pressure Design Parameters Section (Section 5.3). Where with multiple supports are used to support the excavation, research has shown that a distributed pressure diagram more realistically approximates the earth pressure on a shoring system of this type, when restrained by pre-tensioned anchors.

The borehole data indicate that very stiff to hard clayey to sandy silt till would be encountered in the excavations.

For the cohesive soils, a multi-level supported shoring system can be designed based on an earth pressure distribution consisting of a trapezoidal pressure distribution with a maximum pressure defined by:

Where:

P =	0.8 K(γh+ q)
P =	the horizontal pressure (kPa)
K =	the earth pressure coefficient
γ =	the bulk unit weight of soil (kN/m ³)
h =	the depth below the ground surface (m)
q =	the complete surcharge loading (kPa)

The upper quarter of the trapezoid shall be $\frac{1}{4}h$ with zero pressure at grade level and increasing linearly to the maximum. The maximum pressure is applied to within $\frac{1}{4}h$ of the excavation base. The pressure distribution can be diminished linearly from this maximum to zero at the excavation base.

For the cohesionless soils, a multi-level supported shoring system can be designed based on an earth pressure distribution consisting of a rectangular pressure distribution with a maximum pressure defined by:

Where:

$$P = 0.65 K(\gamma h + q)$$

P = the horizontal pressure (kPa)
 K = the earth pressure coefficient
 γ = the bulk unit weight of soil (kN/m³)
 h = the depth below the ground surface (m)
 q = the complete surcharge loading (kPa)

5.12.2 Soldier Pile Toe Design

It is envisaged that the soldier pile will be socketed in the glacial till strata. The horizontal resistance of the soldier pile toes will be developed by the embedment below the base of excavation where resistance is developed from passive earth pressure. It is noted that where soils exist beneath the groundwater level, the unit weight of the soil is diminished by buoyancy, and therefore, the resistance from these soils will be different depending on whether the soils are dewatered, or remain below the nominal groundwater level. The design of the shoring should therefore consider the construction plan and sequence with respect to depth of groundwater control. There may be zones of material within the subsurface soils which may be wet and permeable such that augered borings for soldier piles made into these soils may be unstable. In these cases, it will be necessary to advance temporarily cased holes and/or use of drilling mud/polymer to prevent excess caving and maintain base stability during the soldier pile installations.

5.12.3 Shoring Support

It will be necessary to secure encroachment agreements from the Region/City and the adjacent land owners, in order to use soil anchors on the adjoining properties. Pre-construction condition surveys should be carried out for the adjacent structures to establish existing conditions prior to excavation and mitigate the possibility of spurious claims for excavation induced damages. Access to the properties for such surveys must be part of any encroachment agreements.

A careful evaluation of the subsurface soil conditions is required by the shoring designer to establish appropriate levels/elevations and design the soil anchors. The anchor design will be governed by the weakest material in the profile. It is imperative that a detailed design is carried out at different anchor levels and locations, and the anchors must be tested at each level.

Consideration should be given a post-grouted anchor system which may be a more feasible option for this site. The design adhesion for post-grouted earth anchors is controlled as much by the installation technique as the soil and therefore a proto-type anchor must be made and performance tested to 200% of the design load at each anchor level to demonstrate the anchor capacity and validate the design assumptions. This test must be completed before production anchors are made. All production anchors must be proof-tested to 133% of the design load, to validate the design assumptions.

Depending upon the location and elevation, the anchors made in glacial till at this site may be designed based on a working bond adhesion of 40 to 50 kPa. The post-grouted anchors (150-mm-diameter) may carry from about 50 to 60 kN/metre of length depending upon the material type as confirmed by a performance/load test. Anchors made in bedrock of the Georgian Bay Formation may be designed using a factored ULS adhesion of 620 kPa. It should be noted that these values are provided as preliminary guidance only and the actual anchor performance must be verified by a performance/load test.

Regardless, the subsurface soil information should be reviewed by the shoring designer to decide on the suitable type of earth anchors and anchor capacity to be employed at this site.

If adjacent land owners are not agreeable to anchored support then internal bracing or rakers would be necessary. The footings for the rakers would be made in very stiff to hard undisturbed native soils where they could be designed for a bearing pressure of 200 kPa when inclined at 45 degrees.

5.13 Quality Control

Excavations on this site must be shored to preserve the integrity of the surrounding properties and structures. The Ontario Building Code 2012 stipulates that engineering review of the subsurface conditions is required on a continuous basis during the installation of earth retaining structures. Terraprobe should be retained to provide this review, which is an integral part of the geotechnical design function as it relates to the shoring design considerations. Terraprobe can provide detailed shoring design services for the project, if requested. All foundations must be monitored by the geotechnical engineer on a continuous basis as they are constructed. The on-site review of the condition of the foundation soil as the foundations are constructed is an integral part of the geotechnical design function and is required by Section 4.2.2.2 of the Ontario Building Code 2012. If Terraprobe is not retained to carry out foundation evaluations during construction, then Terraprobe accepts no responsibility for the performance or non-performance of the foundations, even if they are ostensibly constructed in accordance with the conceptual design advice provided in this report.

Concrete for this structure will be specified in accordance with the requirements of CAN3 - CSA A23.1. Terraprobe maintains a CSA certified concrete laboratory and can provide concrete sampling and testing services for the project as necessary.

The requirements for fill placement on this project should be stipulated relative to SPMDD, as determined by ASTM D698. In-situ determinations of density during fill placement by Procedure Method B of ASTM D2922 are recommended to demonstrate that the contractor is achieving the specified soil density. Terraprobe is a CNSC licensed operator of appropriate nuclear density gauges for this work and can provide sampling and testing services for the project as necessary.

Terraprobe can provide thorough in-house resources, quality control services for Building Envelope, Roofing and Structural Steel in accordance with CSA W178, as necessary, for the Structural and Architectural quality control requirements of the project. Terraprobe is certified by the Canadian Welding Bureau under W178.1-1996.

6 LIMITATIONS AND RISK

6.1 Procedures

This investigation has been carried out using investigation techniques and engineering analysis methods consistent with those ordinarily exercised by Terraprobe and other engineering practitioners, working under similar conditions and subject to the time, financial and physical constraints applicable to this project. The discussions and recommendations that have been presented are based on the factual data obtained by Terraprobe.

It must be recognized that there are special risks whenever engineering or related disciplines are applied to identify subsurface conditions. Even a comprehensive sampling and testing programme implemented in accordance with the most stringent level of care may fail to detect certain conditions. Terraprobe has assumed for the purposes of providing design parameters and advice, that the conditions that exist between sampling points are similar to those found at the sample locations. The conditions that Terraprobe has interpreted to exist between sampling points can differ from those that actually exist.

It may not be possible to drill a sufficient number of boreholes or sample and report them in a way that would provide all the subsurface information that could affect construction costs, techniques, equipment and scheduling. Contractors bidding on or undertaking work on the project should be directed to draw their own conclusions as to how the subsurface conditions may affect them, based on their own investigations and their own interpretations of the factual investigation results, cognizant of the risks implicit in the subsurface investigation activities so that they may draw their own conclusions as to how the subsurface conditions may affect them.

6.2 Changes in Site and Scope

It must also be recognized that the passage of time, natural occurrences, and direct or indirect human intervention at or near the site have the potential to alter subsurface conditions. Groundwater levels are particularly susceptible to seasonal fluctuations.

The discussion and recommendations are based on the factual data obtained from this investigation made at the site by Terraprobe and are intended for use by the owner and its retained designers in the design phase of the project. If there are changes to the project scope and development features, the interpretations made of the subsurface information, the geotechnical design parameters and comments relating to constructability issues and quality control may not be relevant or complete for the revised project. Terraprobe should be retained to review the implications of such changes with respect to the contents of this report.

This report was prepared for the express use of Ranee Management and their retained design consultants and is not for use by others. This report is copyright of Terraprobe Inc. and no part of this report may be reproduced by any means, in any form, without the prior written permission of Terraprobe Inc. and Ranee Management who are the authorized users.

It is recognized that the regulatory agencies in their capacities as the planning and building authorities under Provincial statutes, will make use of and rely upon this report, cognizant of the limitations thereof, both expressed and implied.

We trust the foregoing information is sufficient for your present requirements. If you have any questions, or if we can be of further assistance, please do not hesitate to contact us.

Yours truly,

Terraprobe Inc.




Jeffrey K. Au, M.S., P.Eng., P.E.
Geotechnical Engineer

B. Singh, M.A.Sc., P.Eng.
Principal




ENCLOSURES


TERRAPROBE INC.



FIGURES

TERRAPROBE INC.



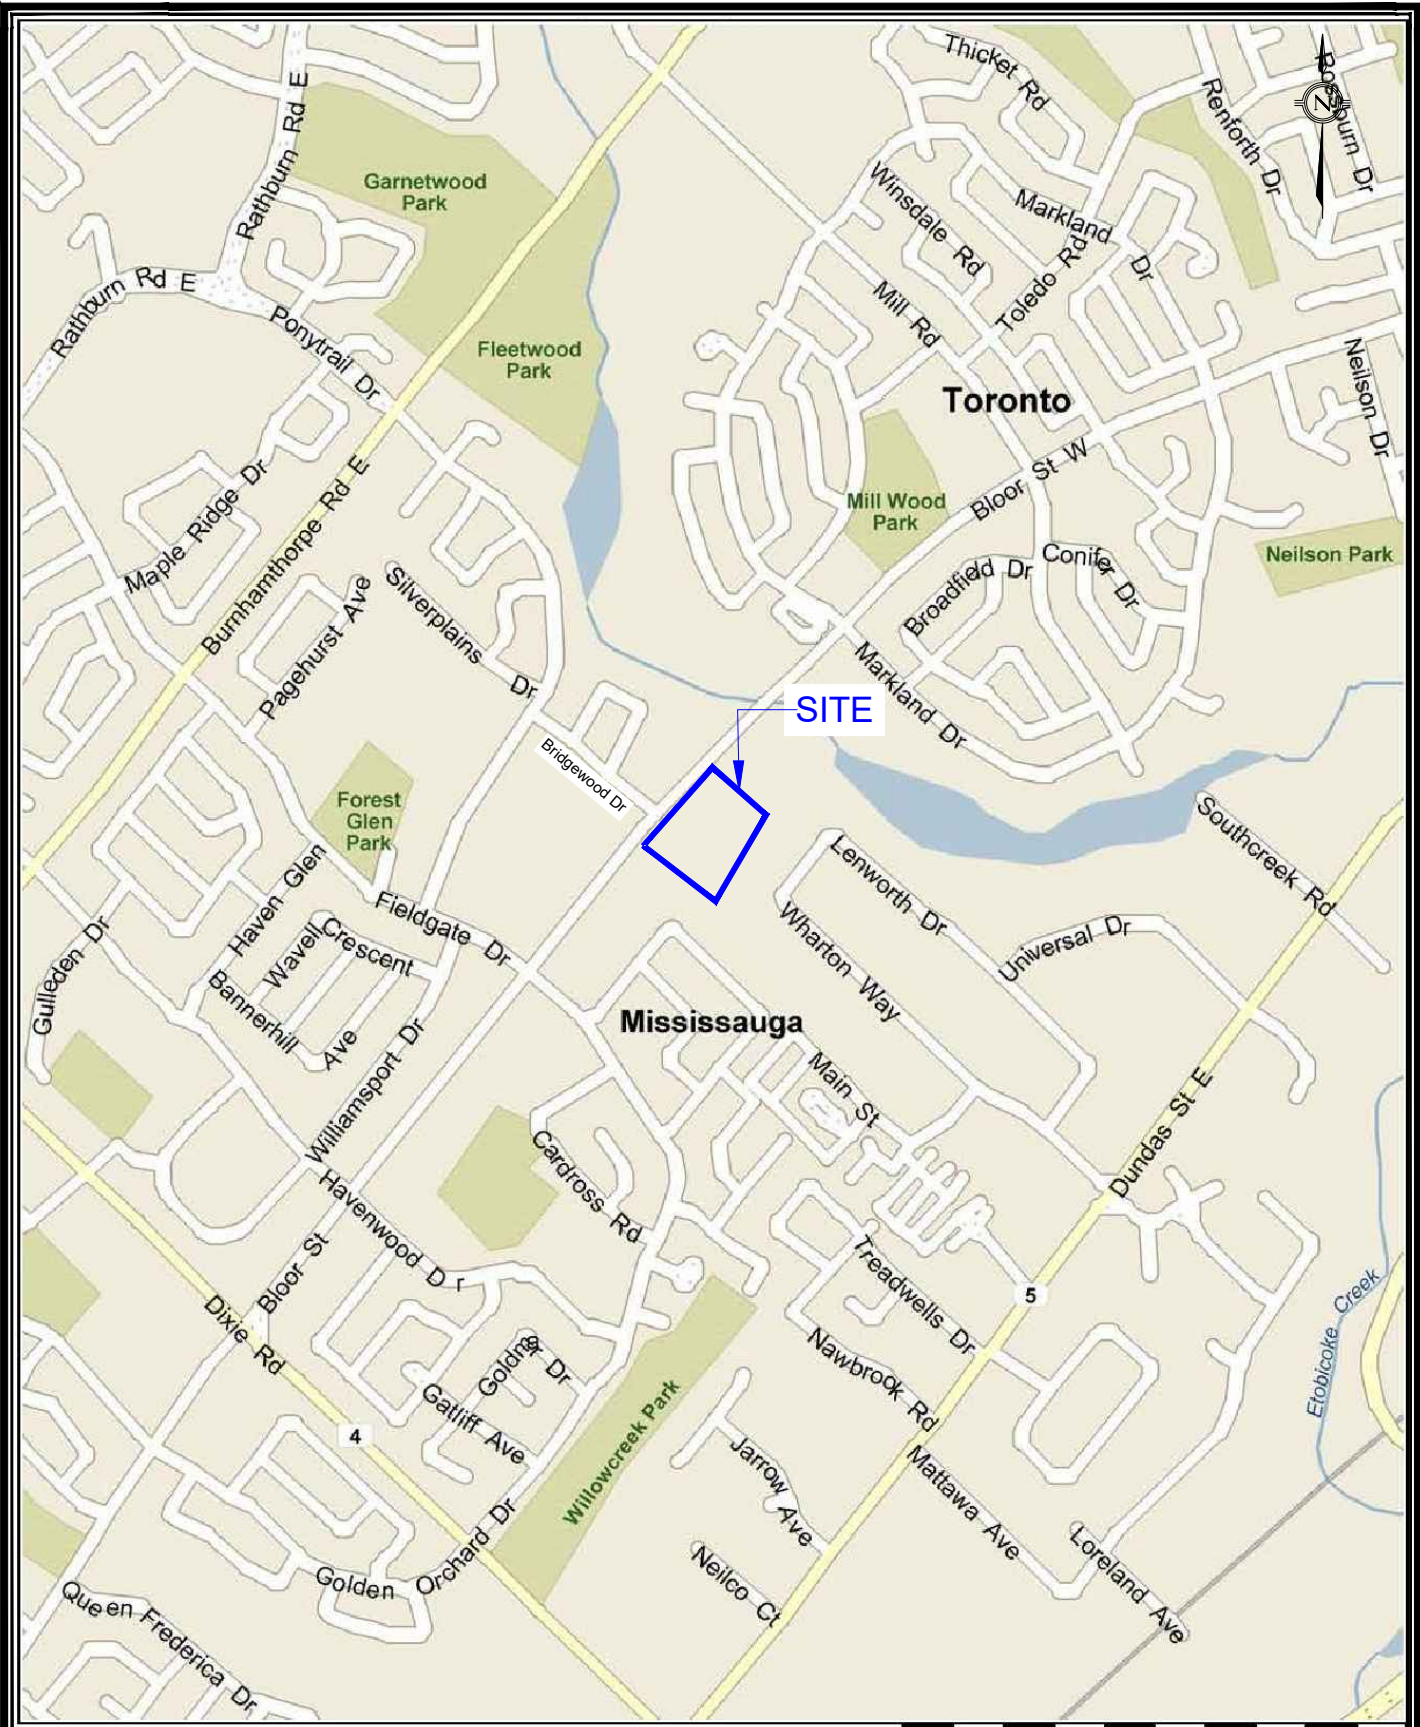

REFERENCE
Microsoft Streets and Trips

0 km 0.2 0.4 0.6 0.8 1



Terraprobe

11 Indell Lane, Brampton, Ontario, L6T 3Y3
Tel: (905) 796-2650 Fax: (905) 796-2250

Title:


SITE LOCATION PLAN

File No.:

1-19-0720-01

FIGURE :

1

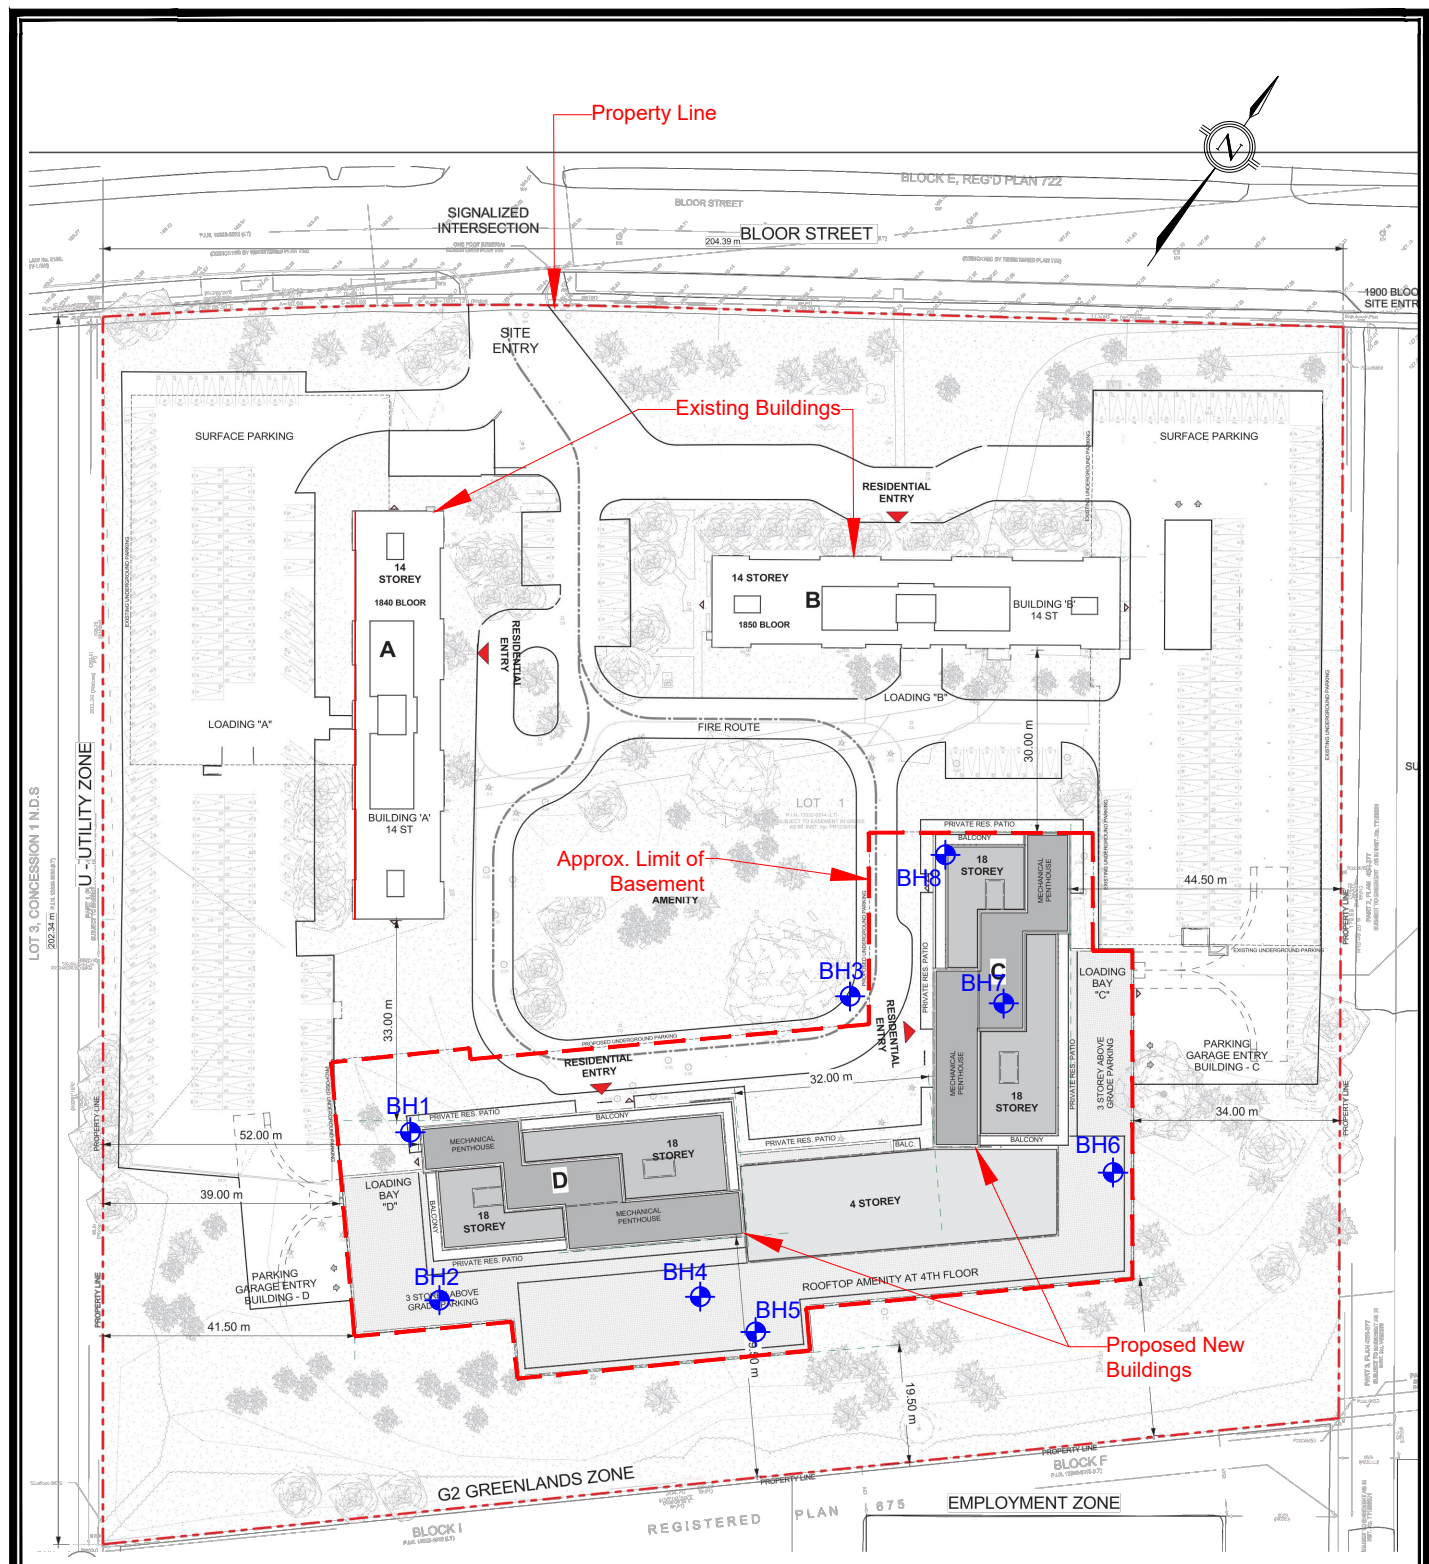

REFERENCE
 Sheet Title: Concept Site Plan
 Project No.: 120303
 Sheet No.: A-003
 By: IBI Group

LEGEND
 ◆ Approximate Borehole Location

SCALE 0 20m

Terraprobe
 11 Indell Lane, Brampton, Ontario, L6T 3Y3
 Tel: (905) 796-2650 Fax: (905) 796-2250


Title: BOREHOLE LOCATION PLAN
File No.: 1-19-0720-01

FIGURE:
 2

Z:\1-Project Files\2019\1-19-0720 - 1840 - 1850 Bloor Street, Mississauga\01 - GDO Investigation\A_Dwg - Logs\Auric\AD\1-19-0720-01 Figure 1 & 2 (2020-01-20).dwg
 Kamal

APPENDIX A

TERRAPROBE INC.





SAMPLING METHODS		PENETRATION RESISTANCE
AS	auger sample	<p>Standard Penetration Test (SPT) resistance ('N' values) is defined as the number of blows by a hammer weighing 63.6 kg (140 lb.) falling freely for a distance of 0.76 m (30 in.) required to advance a standard 50 mm (2 in.) diameter split spoon sampler for a distance of 0.3 m (12 in.).</p> <p>Dynamic Cone Test (DCT) resistance is defined as the number of blows by a hammer weighing 63.6 kg (140 lb.) falling freely for a distance of 0.76 m (30 in.) required to advance a conical steel point of 50 mm (2 in.) diameter and with 60° sides on 'A' size drill rods for a distance of 0.3 m (12 in.)."</p>
CORE	cored sample	
DP	direct push	
FV	field vane	
GS	grab sample	
SS	split spoon	
ST	shelby tube	
WS	wash sample	

COHESIONLESS SOILS		COHESIVE SOILS			COMPOSITION	
Compactness	'N' value	Consistency	'N' value	Undrained Shear Strength (kPa)	Term (e.g)	% by weight
very loose	< 4	very soft	< 2	< 12	<i>trace</i> silt	< 10
loose	4 – 10	soft	2 – 4	12 – 25	<i>some</i> silt	10 – 20
compact	10 – 30	firm	4 – 8	25 – 50	silty	20 – 35
dense	30 – 50	stiff	8 – 15	50 – 100	sand <i>and</i> silt	> 35
very dense	> 50	very stiff	15 – 30	100 – 200		
		hard	> 30	> 200		

TESTS AND SYMBOLS

MH	mechanical sieve and hydrometer analysis		Unstabilized water level
w, w _c	water content		1 st water level measurement
w _L , LL	liquid limit		2 nd water level measurement
w _P , PL	plastic limit		Most recent water level measurement
I _P , PI	plasticity index		
k	coefficient of permeability		
γ	soil unit weight, bulk		
G _s	specific gravity		
φ'	internal friction angle		
c'	effective cohesion		
c _u	undrained shear strength		
		^{3.0} +	Undrained shear strength from field vane (with sensitivity)
		C _c	compression index
		c _v	coefficient of consolidation
		m _v	coefficient of compressibility
		e	void ratio

FIELD MOISTURE DESCRIPTIONS

Damp	refers to a soil sample that does not exhibit any observable pore water from field/hand inspection.
Moist	refers to a soil sample that exhibits evidence of existing pore water (e.g. sample feels cool, cohesive soil is at or close to plastic limit) but does not have visible pore water
Wet	refers to a soil sample that has visible pore water

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 29, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614303, N: 4831204 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

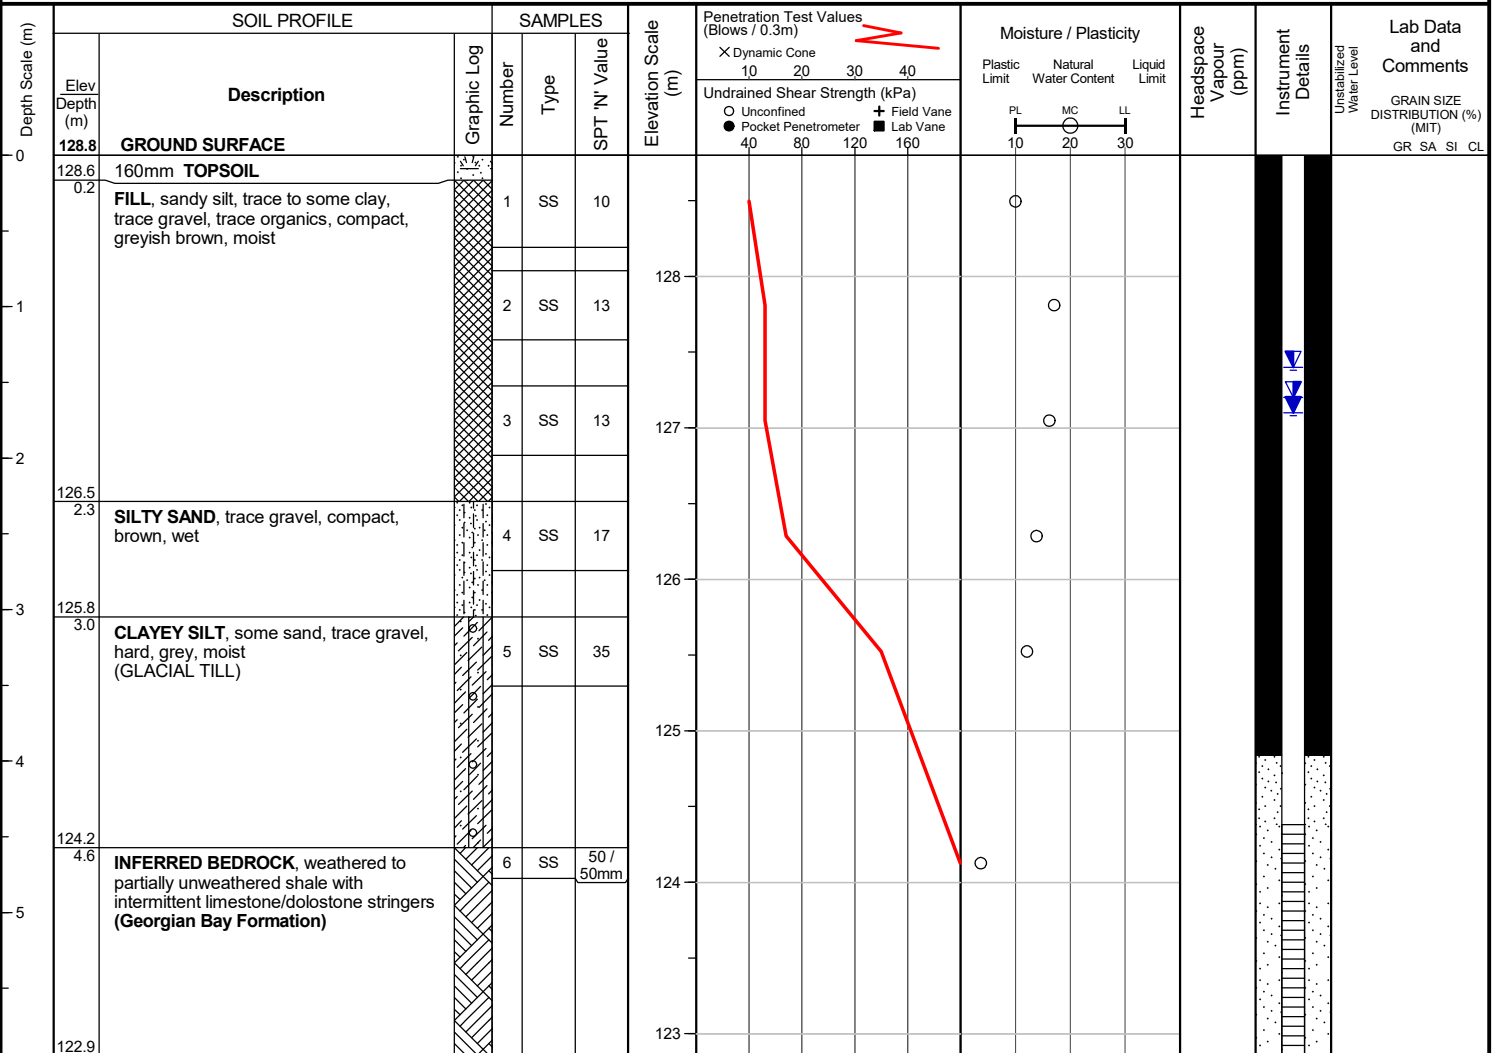
END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

WATER LEVEL READINGS

Date	Water Depth (m)	Elevation (m)
Dec 10, 2019	1.4	127.4
Dec 16, 2019	1.6	127.2
Dec 23, 2019	1.3	127.5
Jan 9, 2020	1.7	127.1

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 29, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614327, N: 4831189 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

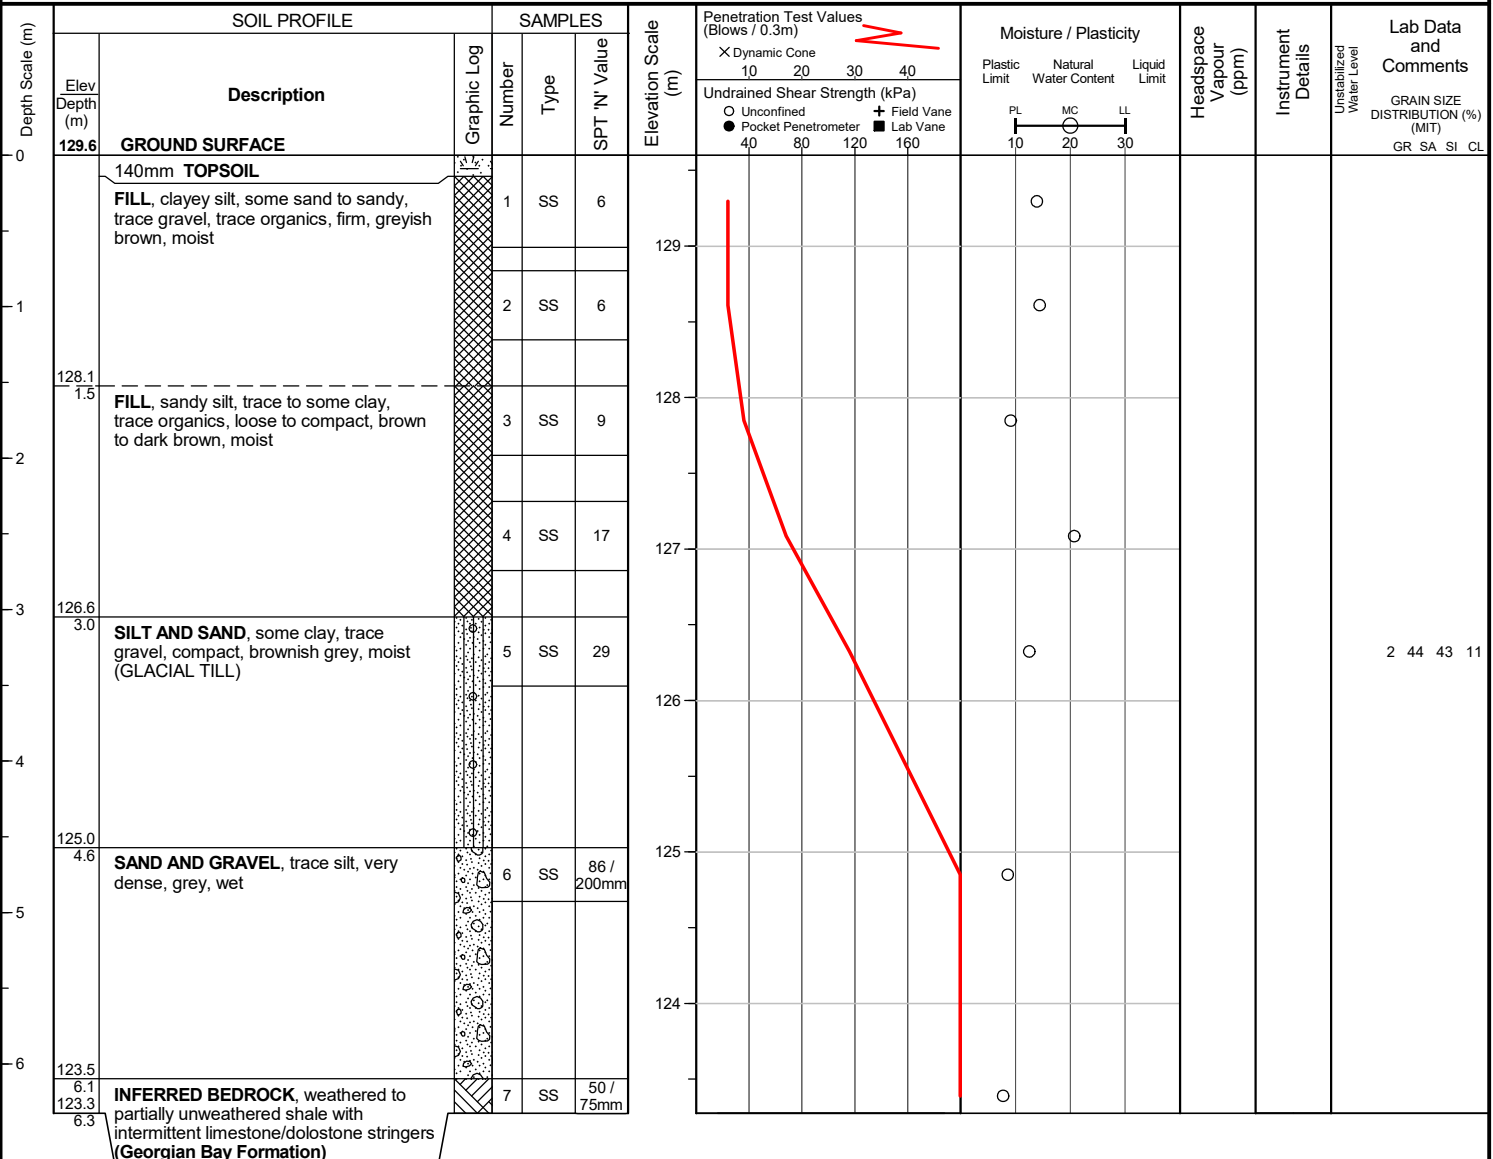
END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 27, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614337, N: 4831274 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

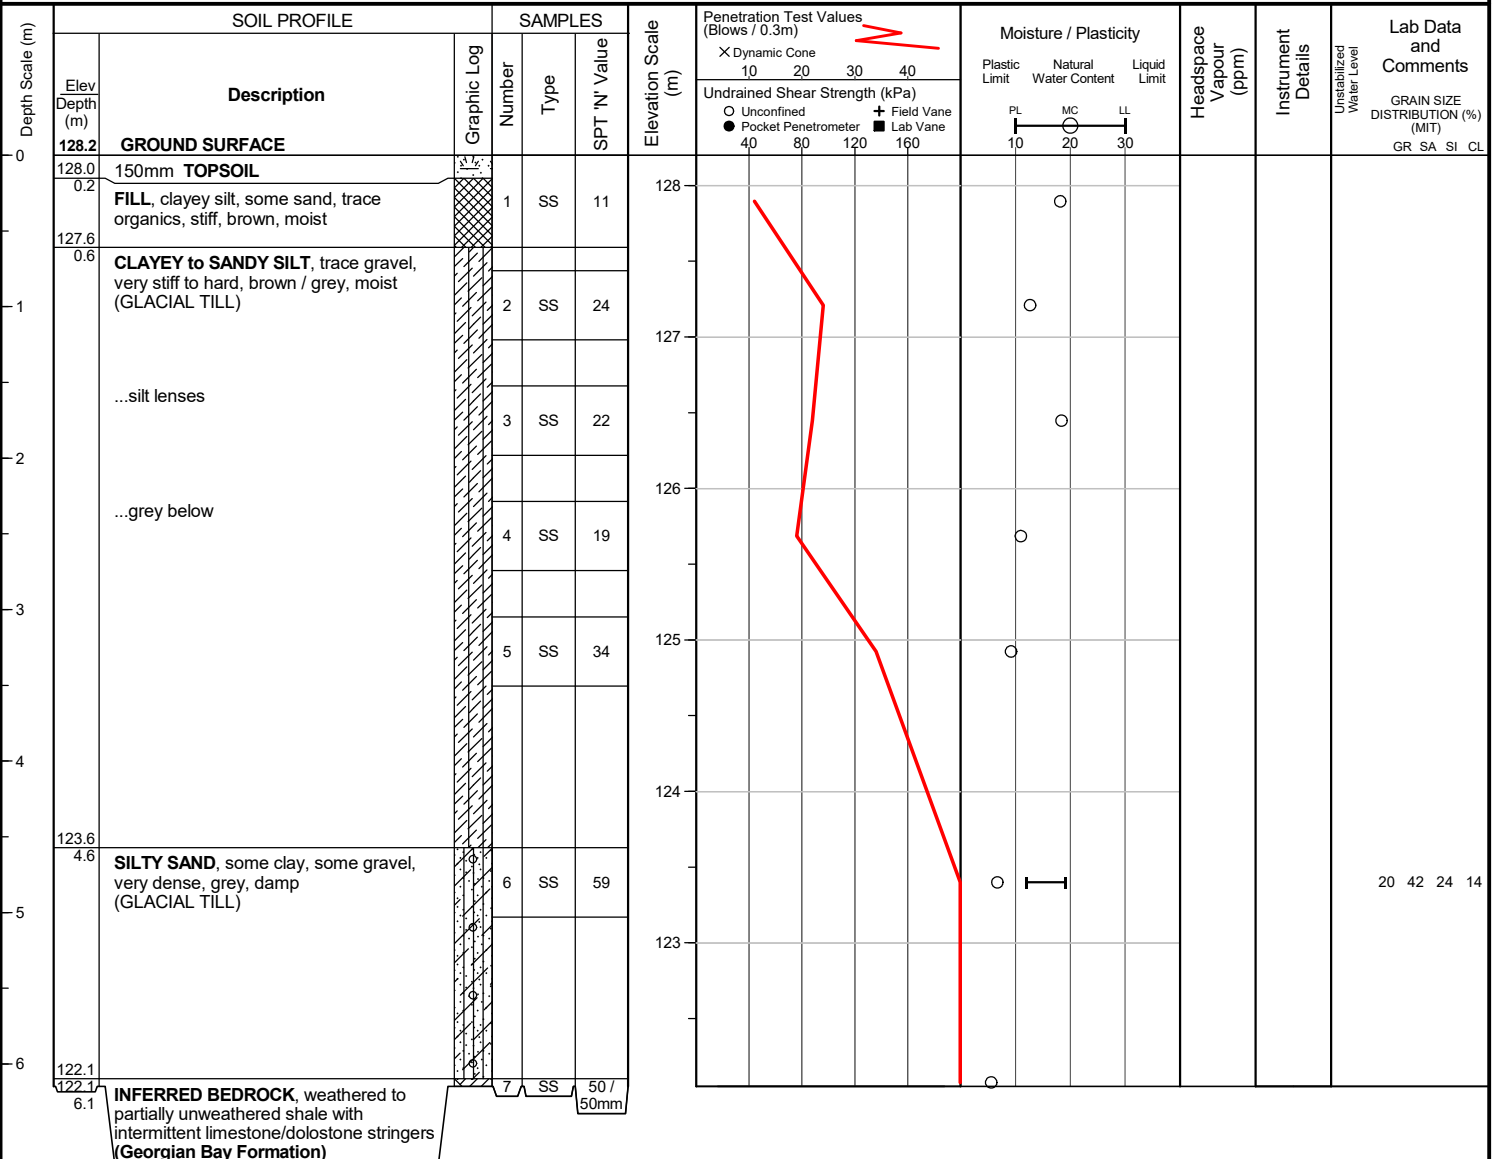
END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 28, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614357, N: 4831221 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

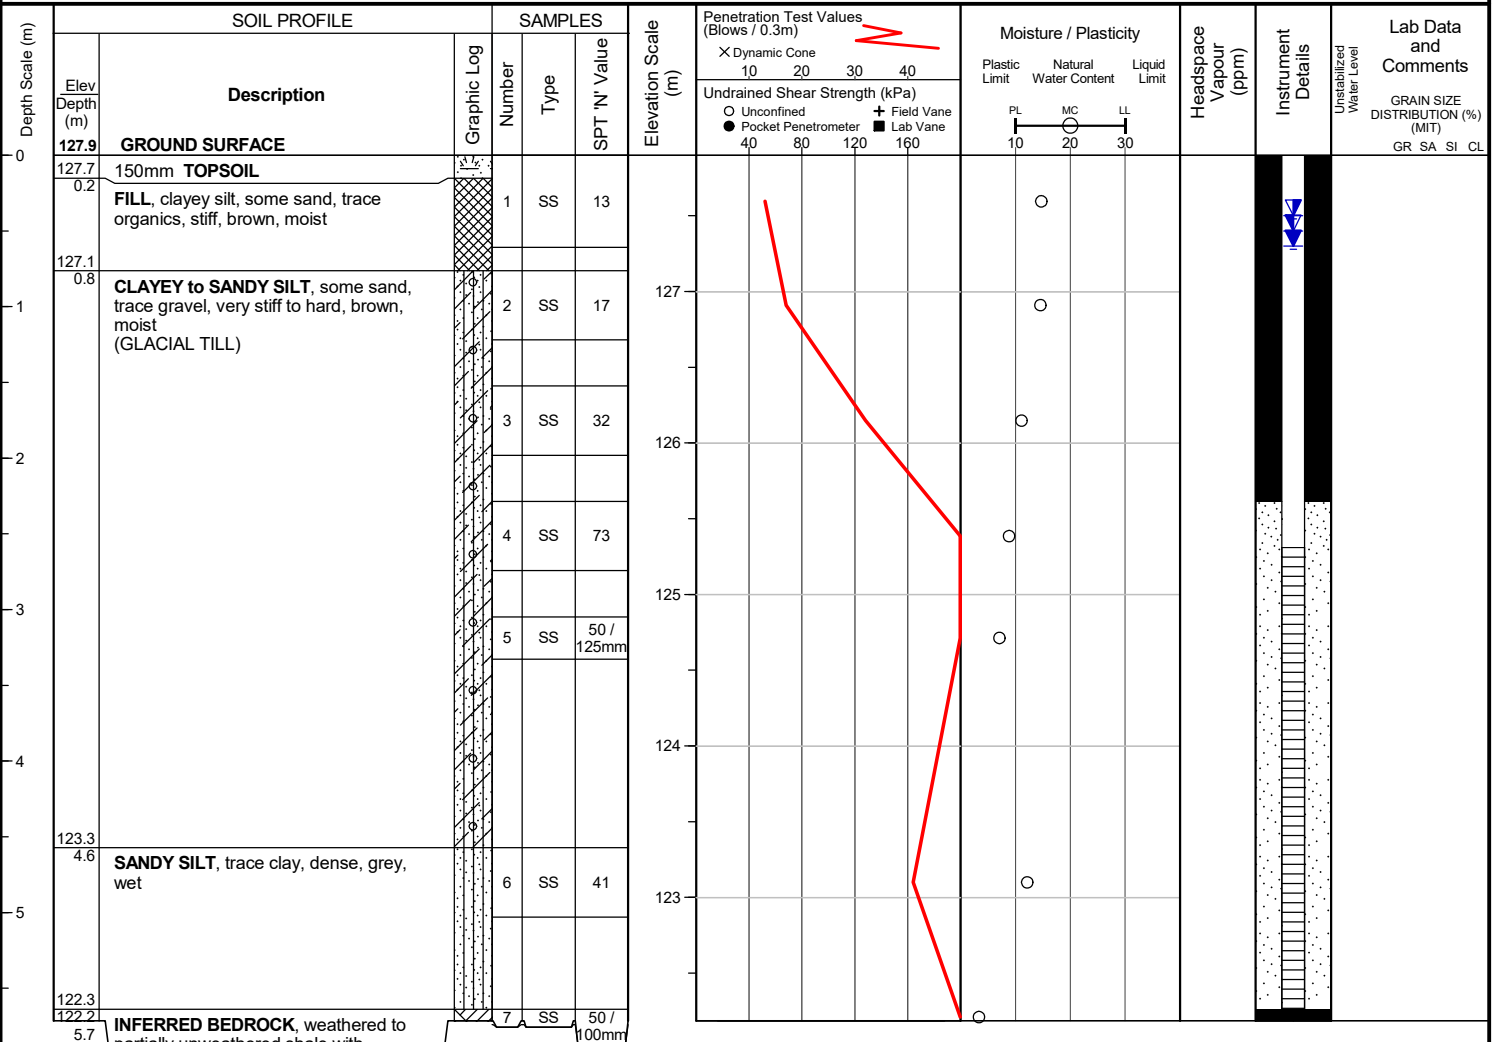
WATER LEVEL READINGS

Date	Water Depth (m)	Elevation (m)
Dec 10, 2019	0.5	127.4
Dec 16, 2019	0.4	127.5
Dec 23, 2019	0.6	127.3
Jan 9, 2020	0.6	127.3

END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 28, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614367, N: 4831224 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

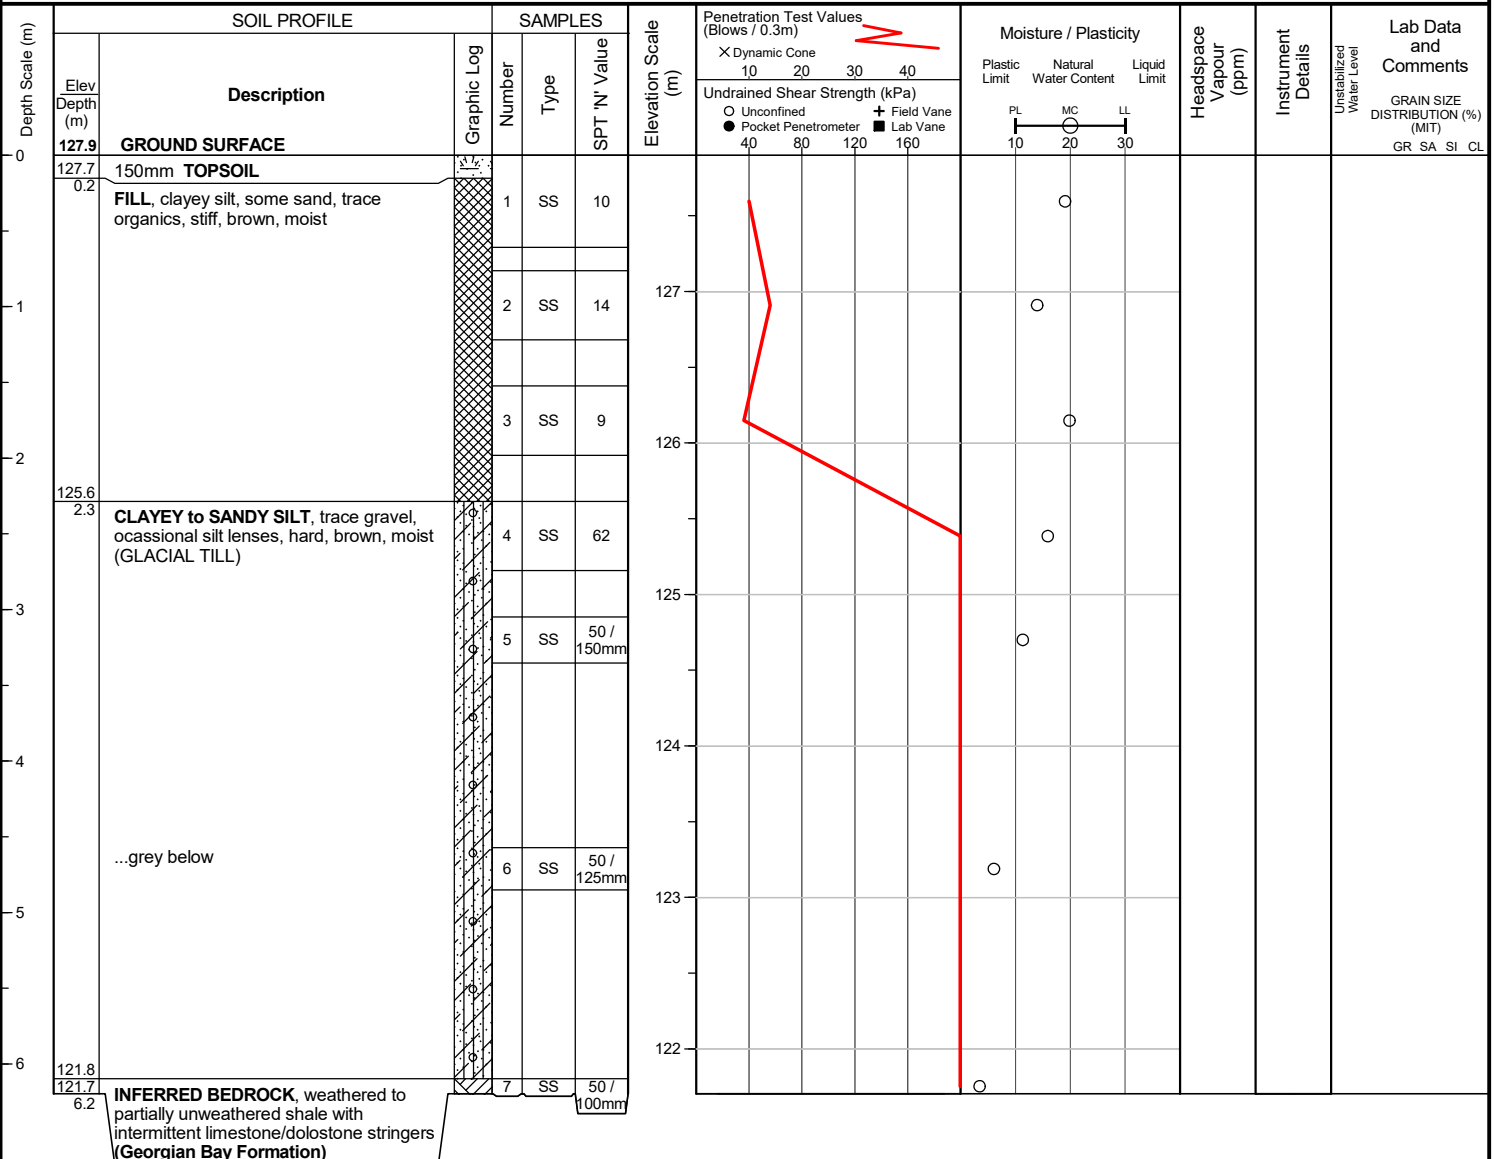
END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 28, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614389, N: 4831286 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

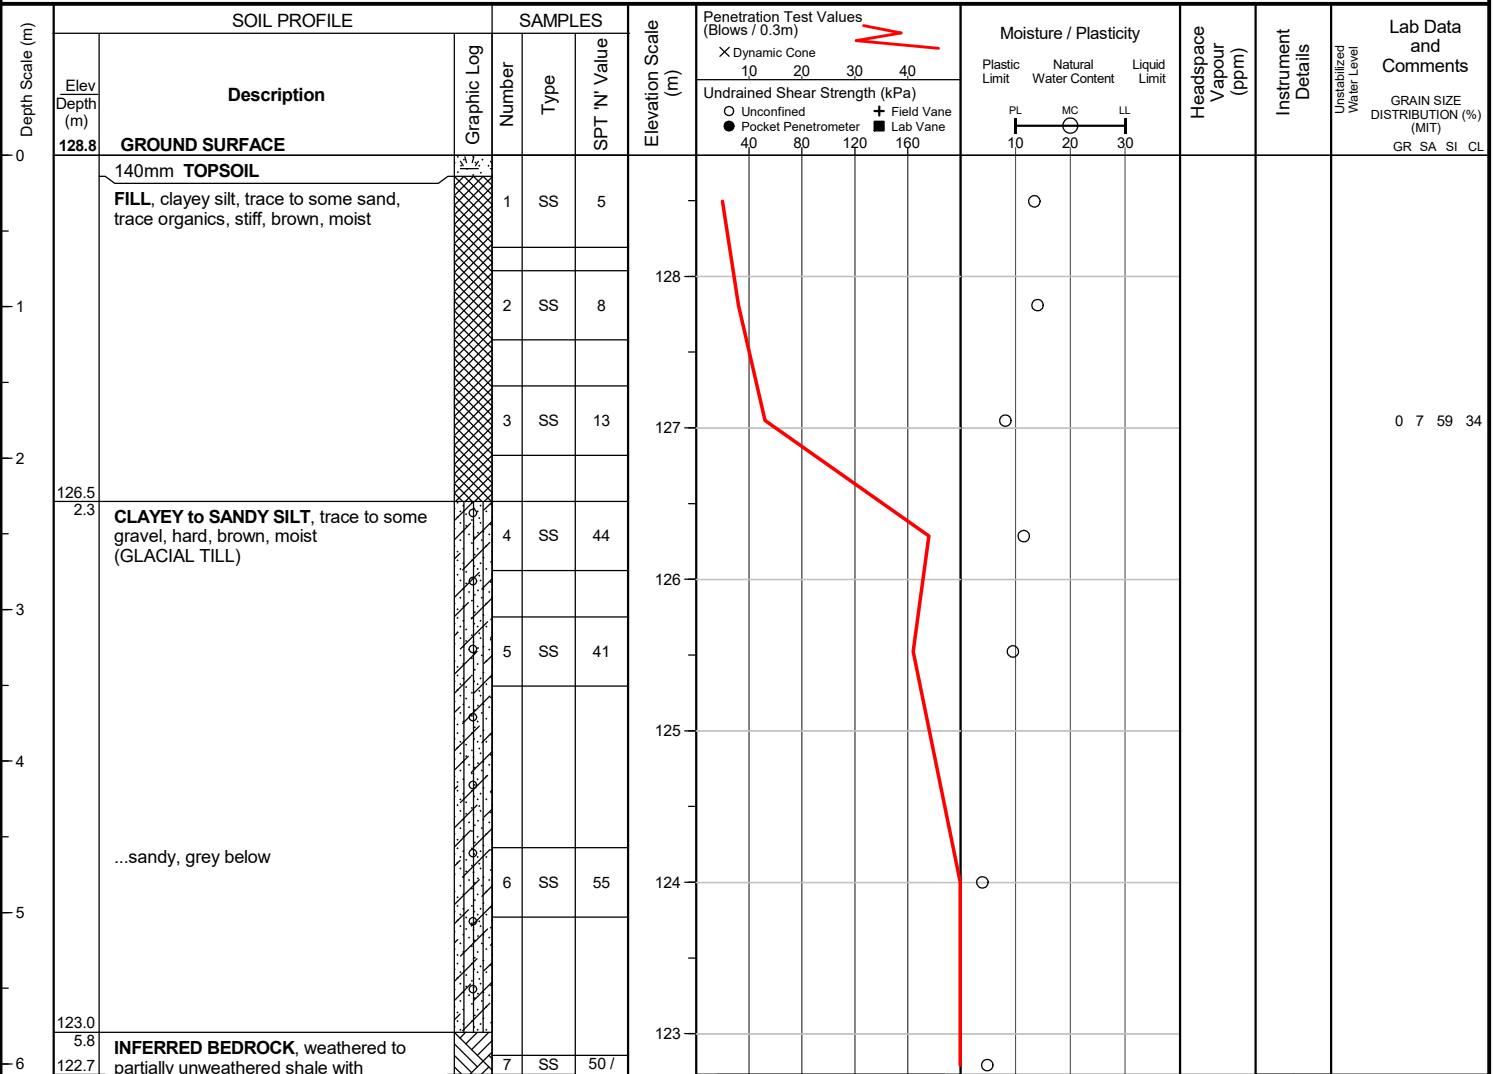
END OF BOREHOLE

Borehole was dry and open upon completion of drilling.

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 27, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614356, N: 4831292 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

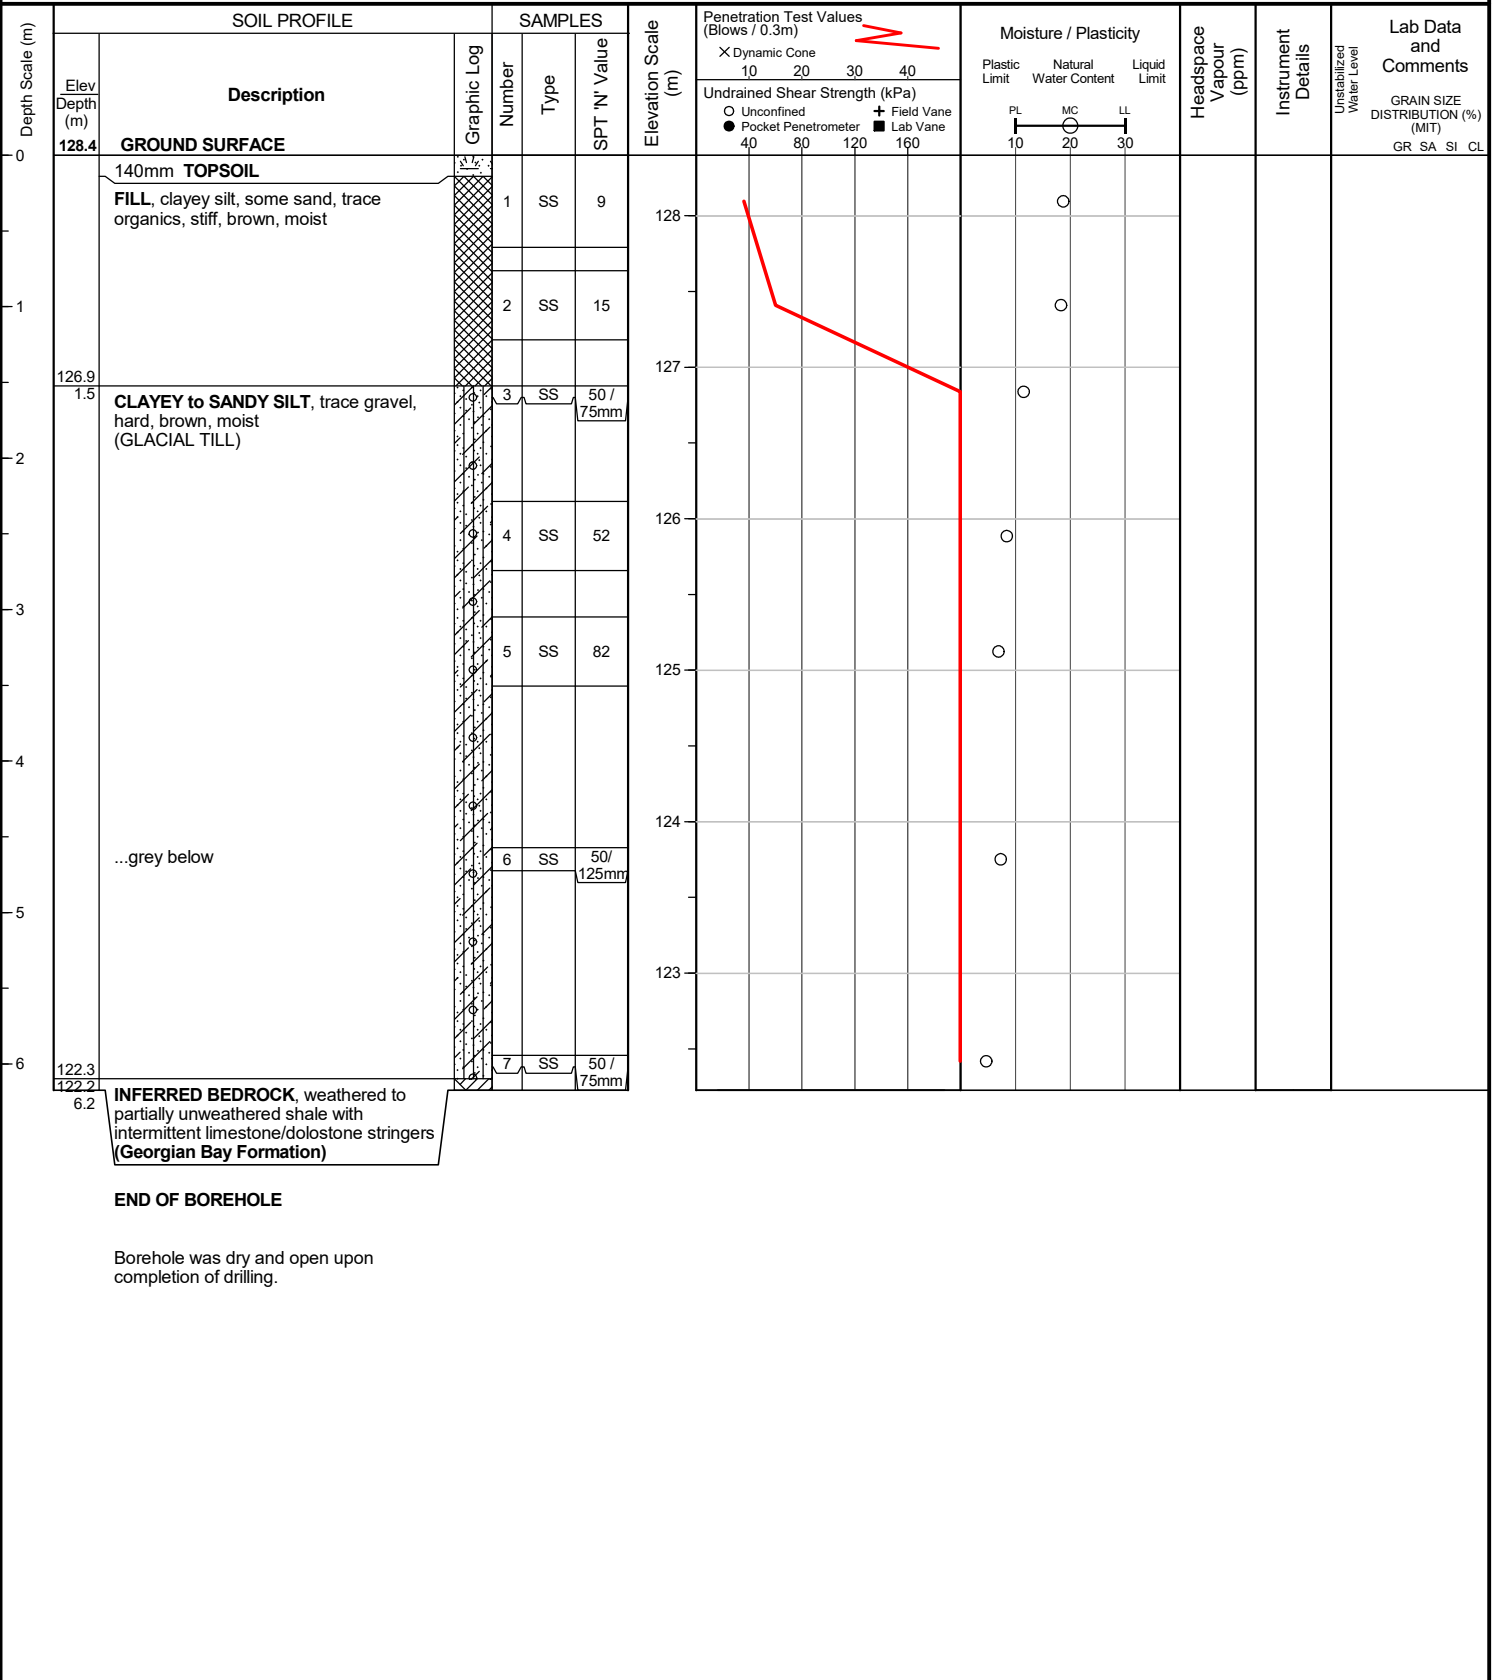

Project No. : 1-19-0720-01

Client : Ranee Management

Originated by : DH

Date started : November 27, 2019

Project : 1840 - 1850 Bloor Street

Compiled by : JKA

Sheet No. : 1 of 1

Location : Mississauga, Ontario


Checked by : BS

Position : E: 614331, N: 4831302 (UTM 17T)

Elevation Datum : Geodetic

Rig type : Track-mounted

Drilling Method : Hollow stem augers

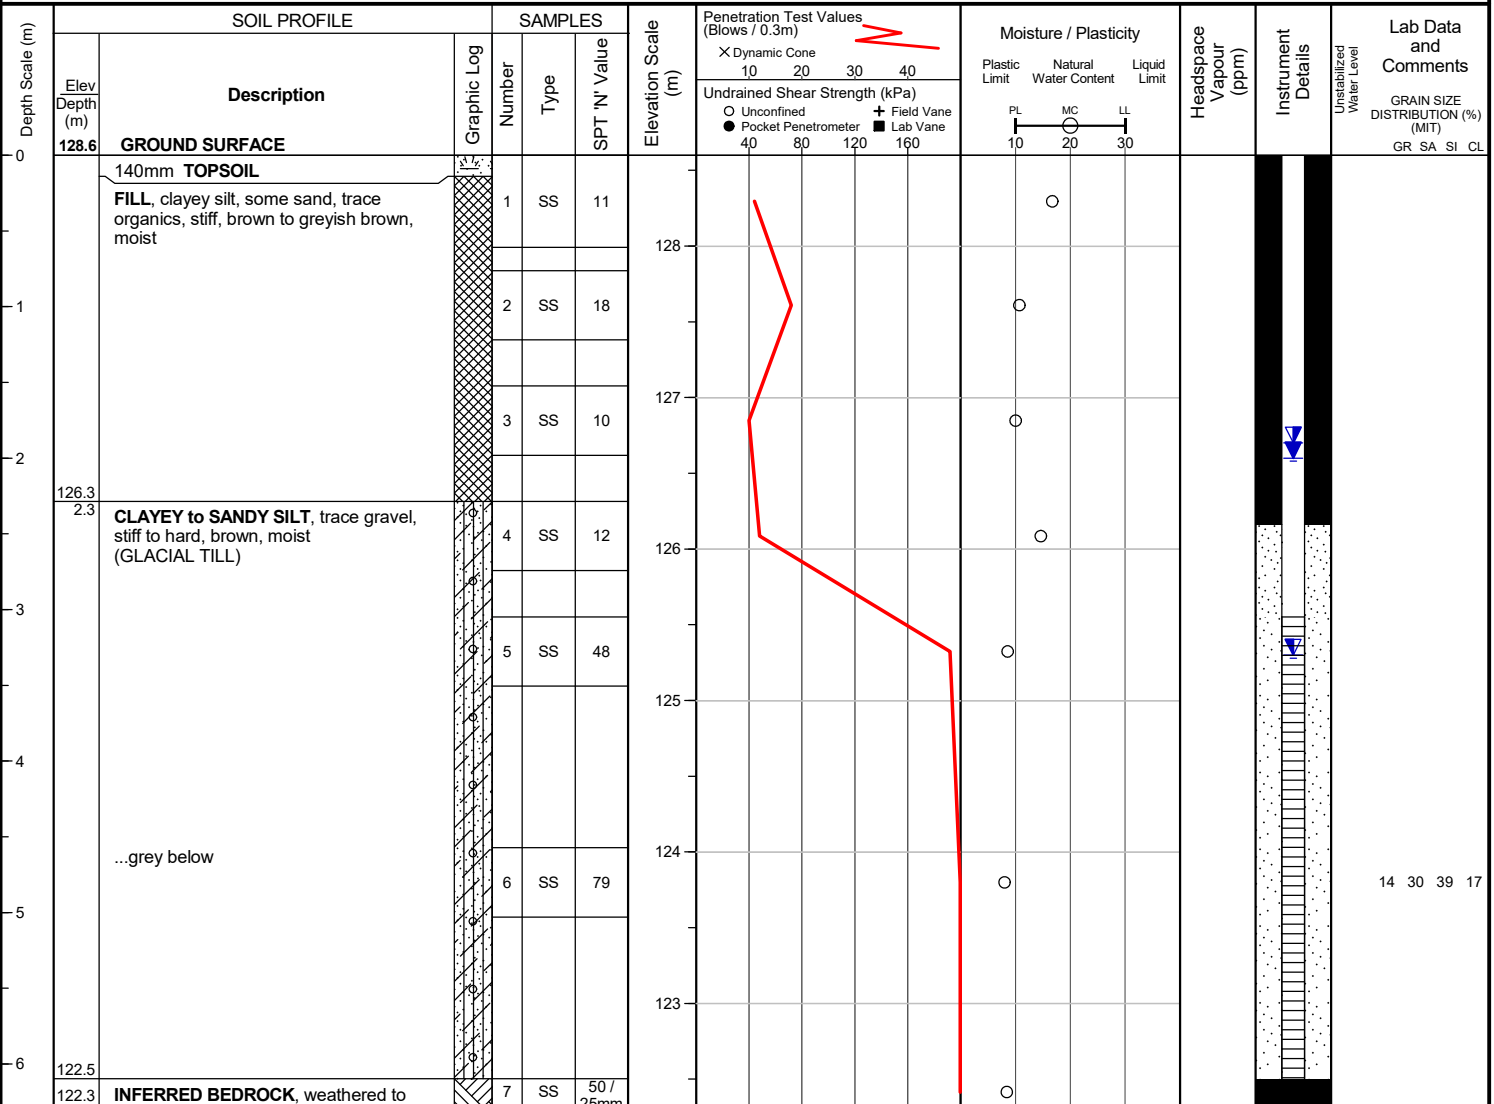

WATER LEVEL READINGS

Date	Water Depth (m)	Elevation (m)
Dec 10, 2019	3.3	125.3
Dec 16, 2019	1.9	126.7
Dec 23, 2019	1.6	127.0
Jan 9, 2020	2.0	126.6


END OF BOREHOLE


Borehole was dry and open upon completion of drilling.

14 30 39 17

APPENDIX B

TERRAPROBE INC.



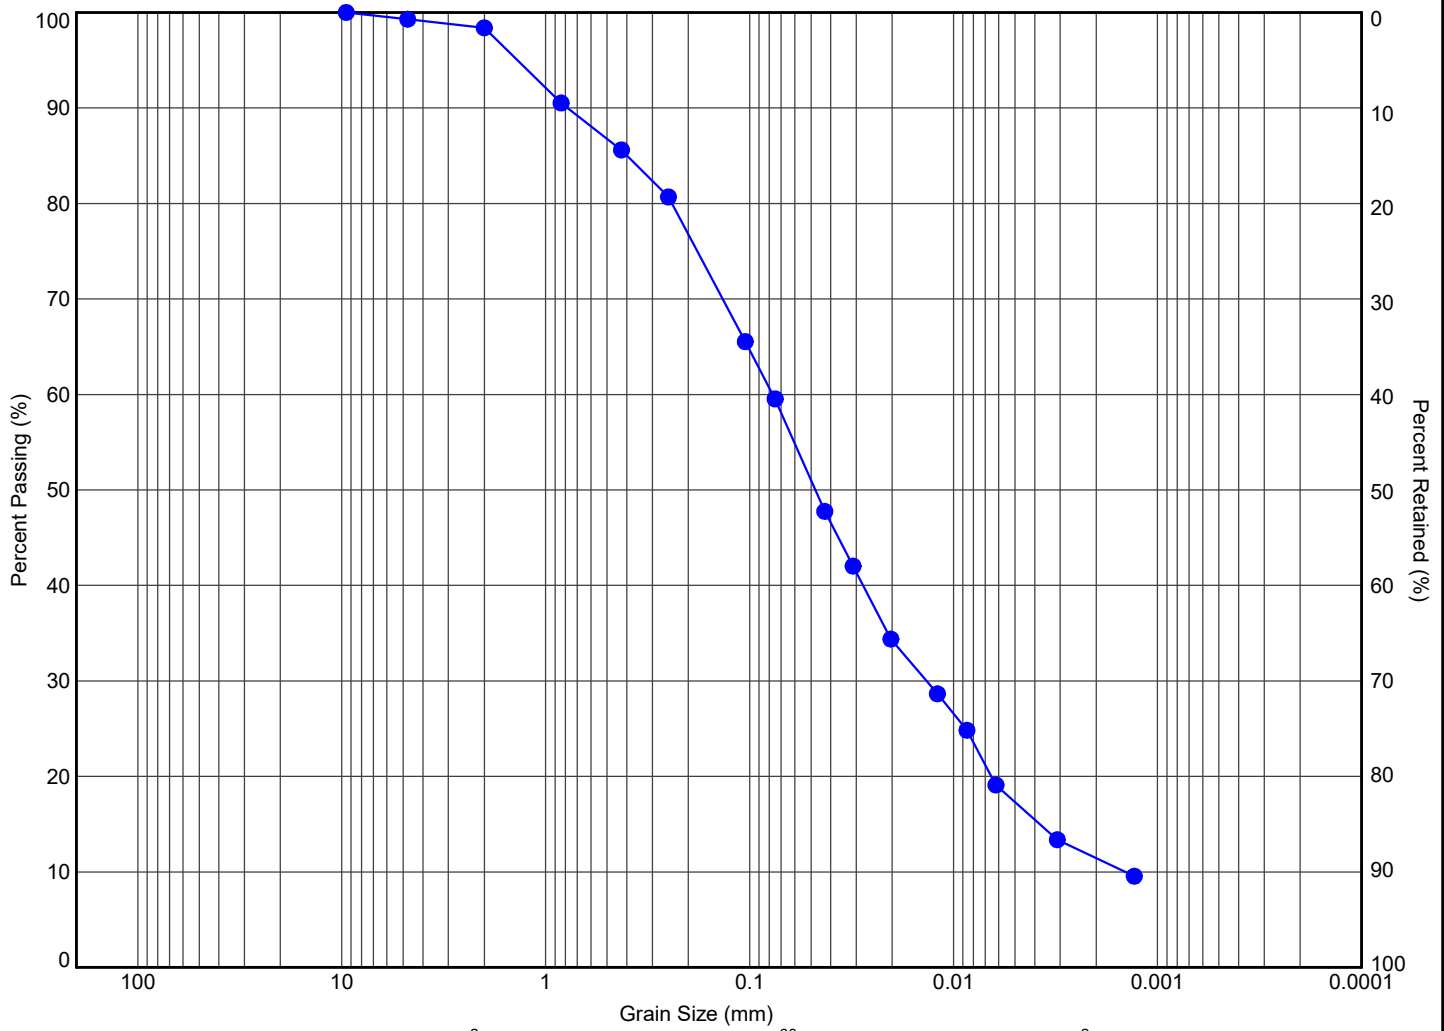

MIT SYSTEM	COBBLES	GRAVEL			SAND			SILT	CLAY
		COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE		

MIT SYSTEM									
Hole ID	Sample	Depth (m)	Elev. (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)	(Fines, %)	
● 2	SS5	3.3	126.3	2	44	43	11		




11 Indell Lane, Brampton Ontario L6T 3Y3
(905) 796-2650

Title:

**GRAIN SIZE DISTRIBUTION
SILT AND SAND, SOME CLAY, TRACE GRAVEL**

File No.:

1-19-0720-01

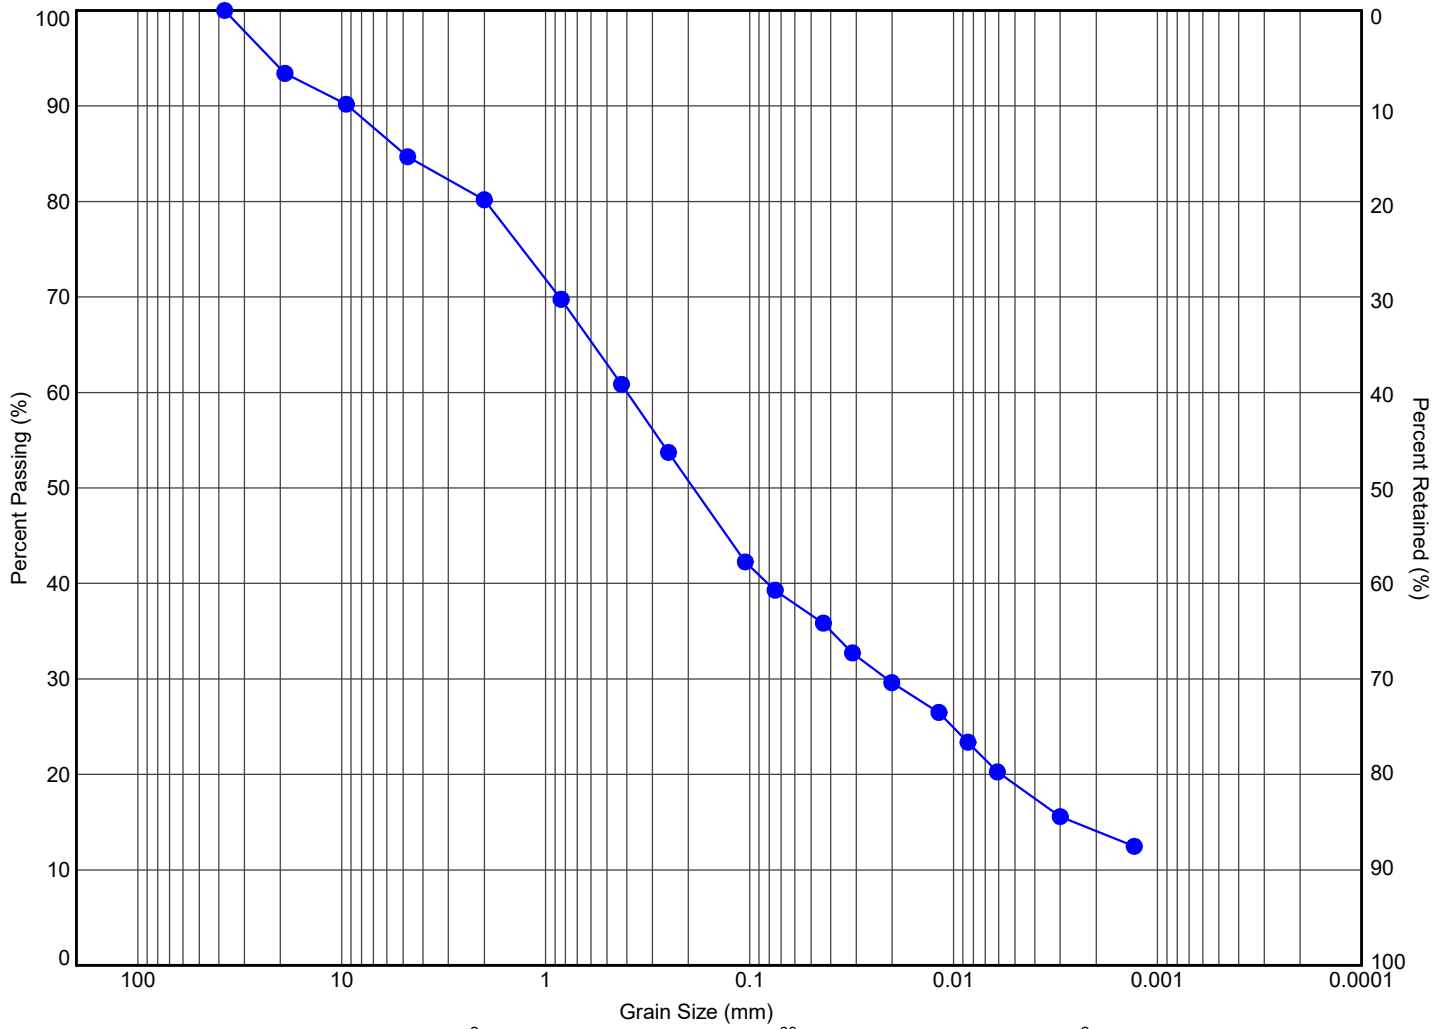

MIT SYSTEM	COBBLES	GRAVEL			SAND			SILT	CLAY
		COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE		

MIT SYSTEM


Hole ID	Sample	Depth (m)	Elev. (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)	(Fines, %)
● 3	SS6	4.8	123.4	20	42	24	14	



11 Indell Lane, Brampton Ontario L6T 3Y3
(905) 796-2650

Title: **GRAIN SIZE DISTRIBUTION
SILTY SAND, SOME GRAVEL, SOME CLAY**

File No.: **1-19-0720-01**

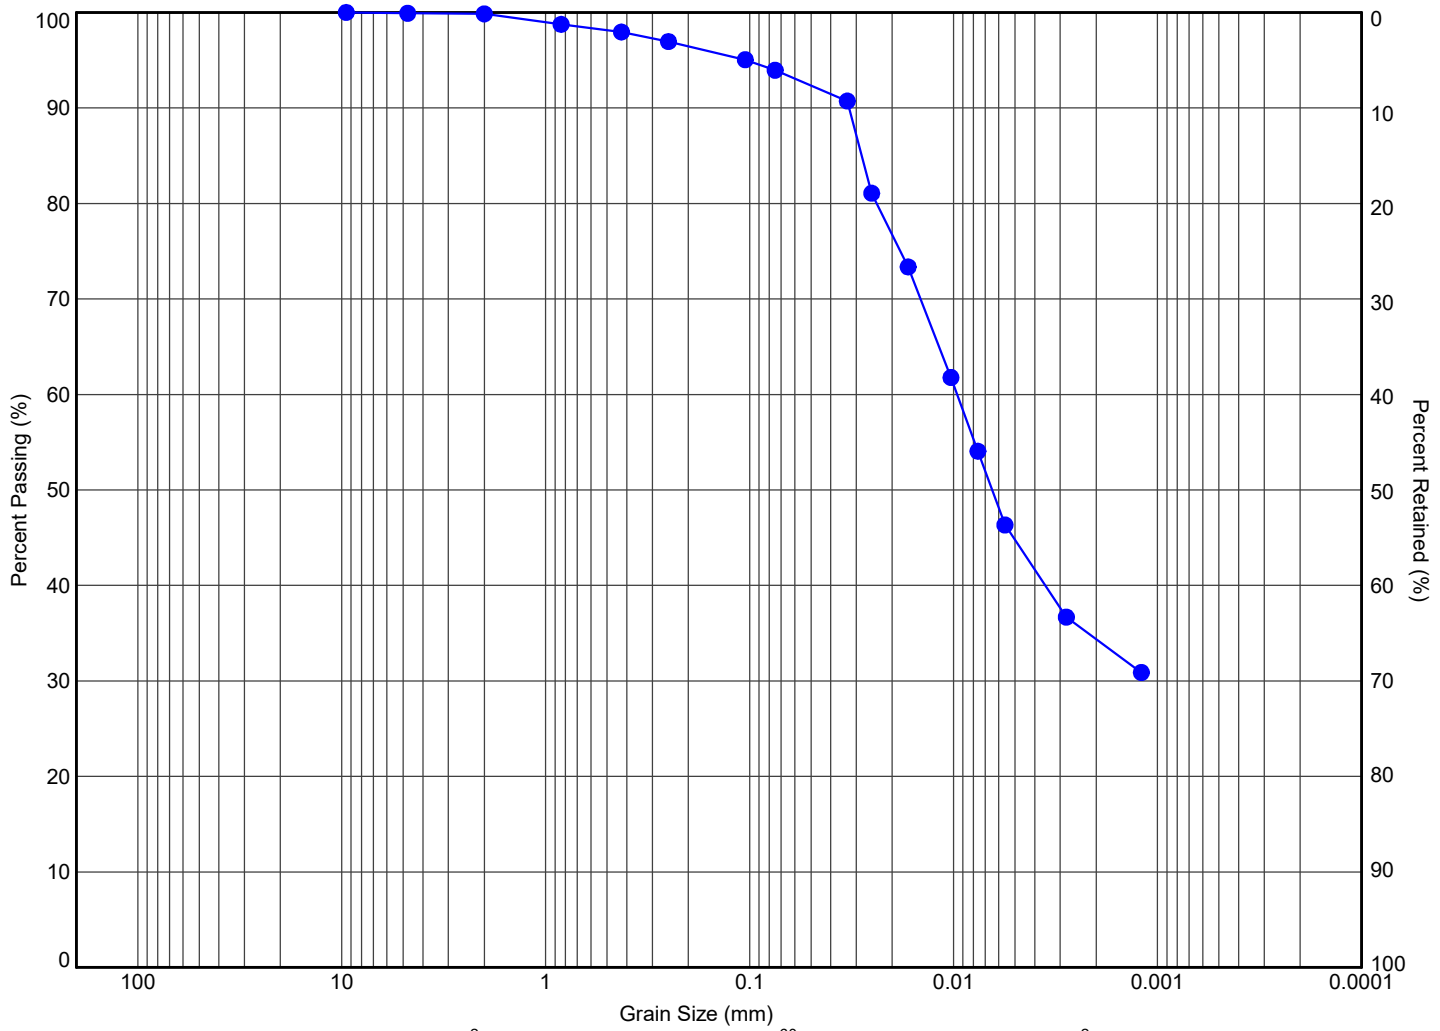

MIT SYSTEM	COBBLES	GRAVEL			SAND			SILT	CLAY
		COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE		

MIT SYSTEM


Hole ID	Sample	Depth (m)	Elev. (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)	(Fines, %)
● 6	SS3	1.8	127.0	0	7	59	34	



11 Indell Lane, Brampton Ontario L6T 3Y3
(905) 796-2650

Title: **GRAIN SIZE DISTRIBUTION
CLAYEY SILT, TRACE SAND**

File No.: **1-19-0720-01**

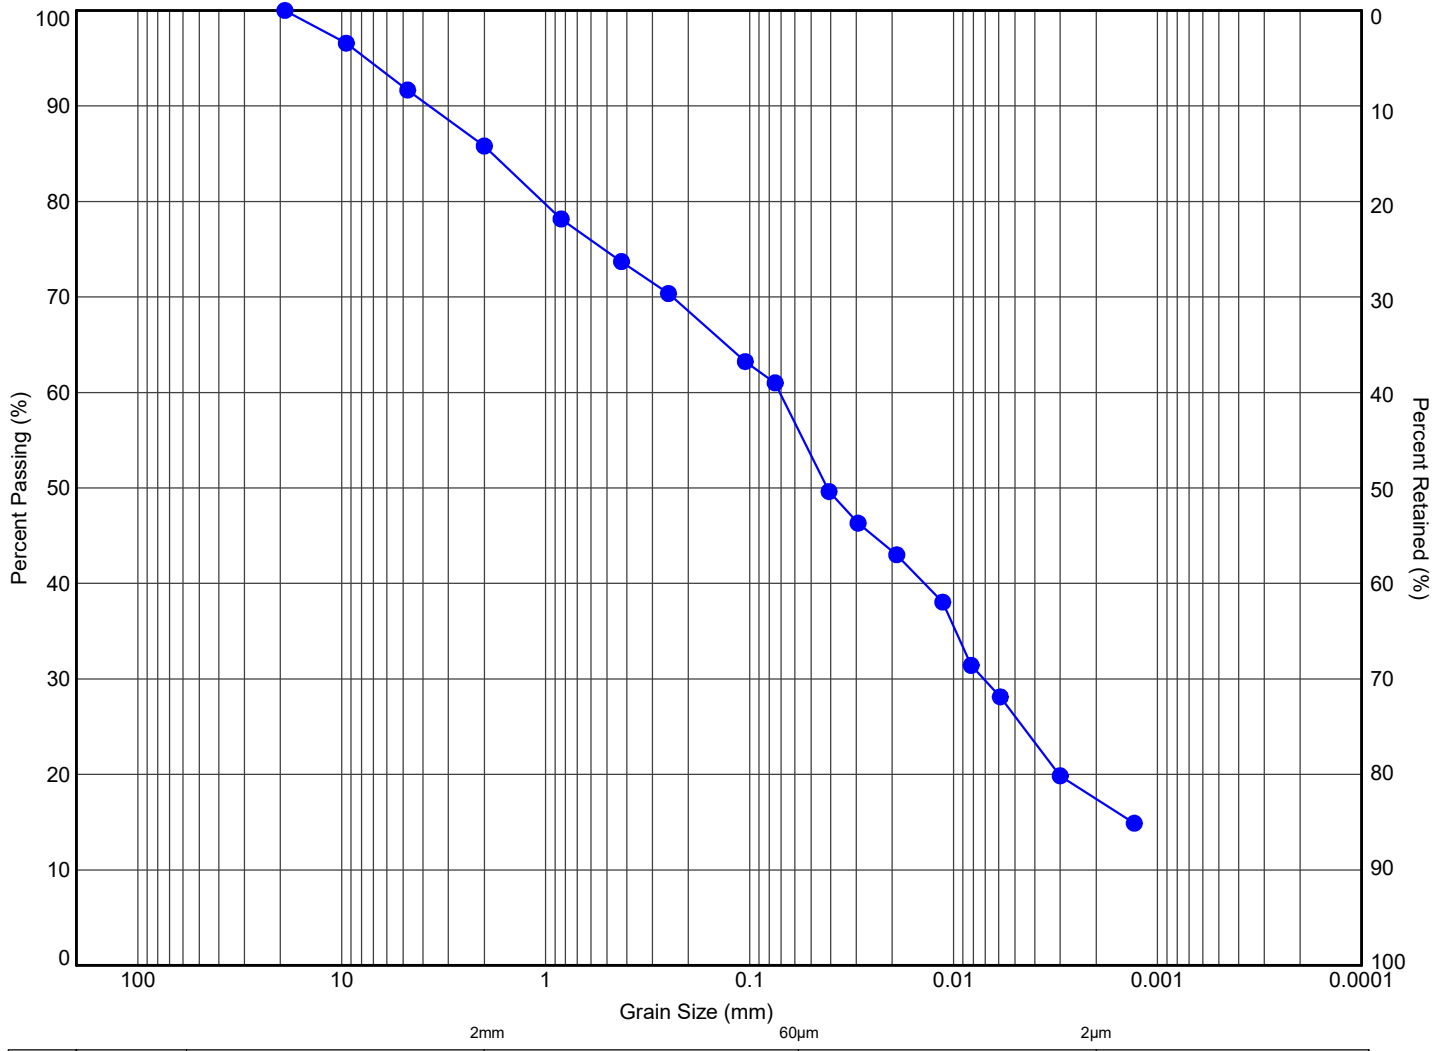

MIT SYSTEM	COBBLES	GRAVEL			SAND			SILT	CLAY
		COARSE	MEDIUM	FINE	COARSE	MEDIUM	FINE		

MIT SYSTEM


Hole ID	Sample	Depth (m)	Elev. (m)	Gravel (%)	Sand (%)	Silt (%)	Clay (%)	(Fines, %)
● 8	SS6	4.8	123.8	14	30	39	17	



11 Indell Lane, Brampton Ontario L6T 3Y3
(905) 796-2650

Title: **GRAIN SIZE DISTRIBUTION**
SANDY SILT, SOME CLAY, SOME GRAVEL

File No.: **1-19-0720-01**

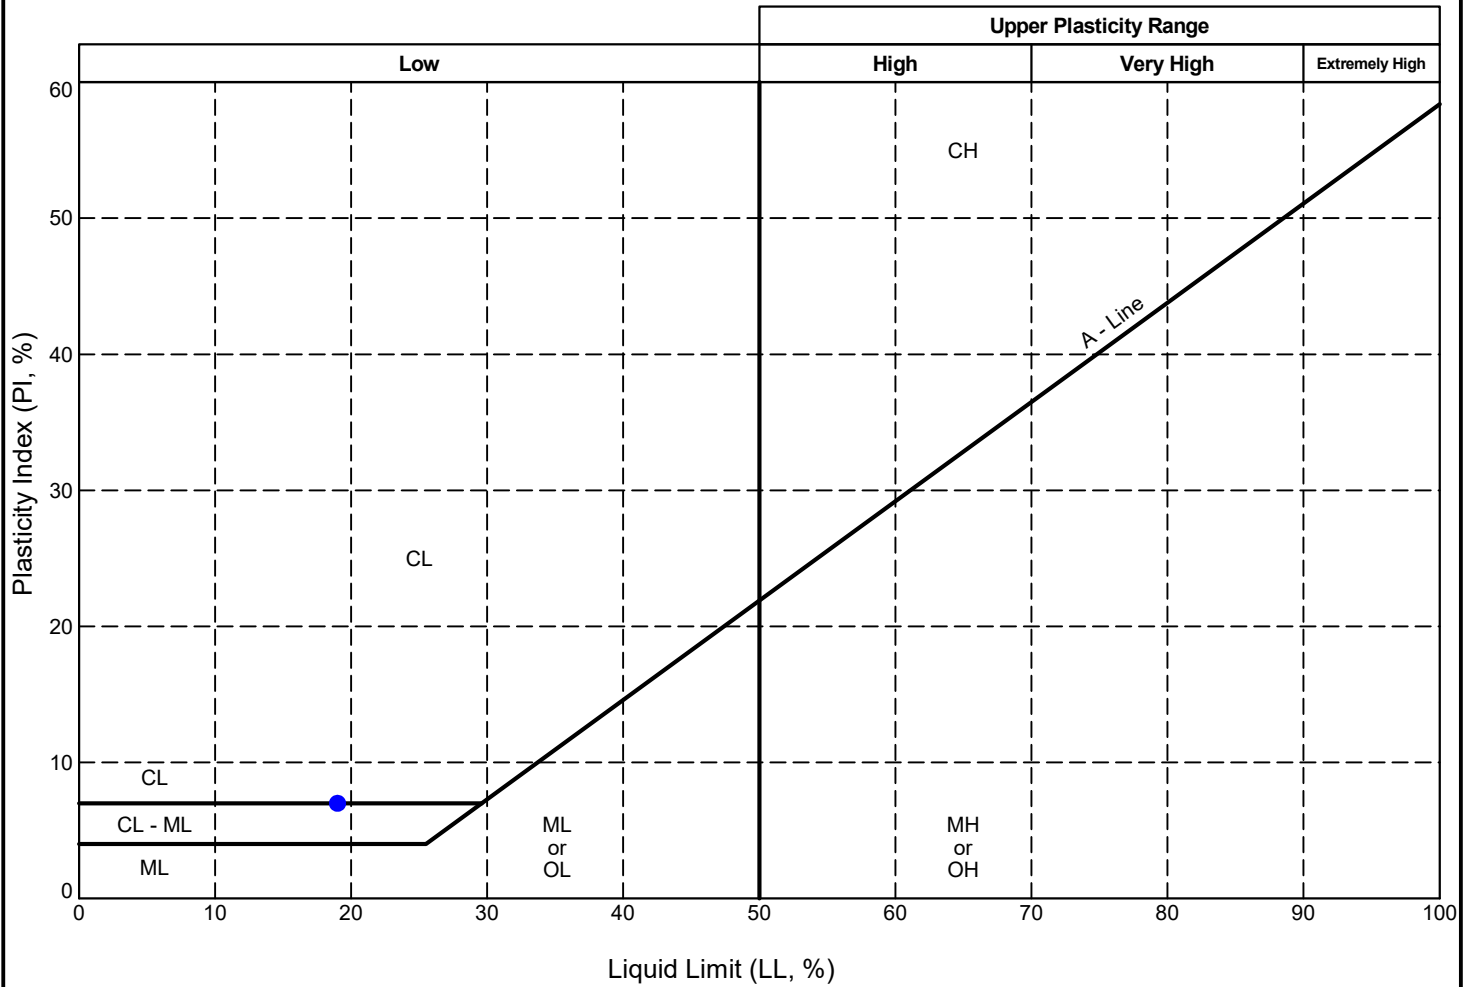

Borehole	Sample	Depth (m)	Elev. (m)	LL (%)	PL (%)	PI (%)	Description
● 3	SS6	4.8	123.4	19	12	7	SLIGHTLY PLASTIC



11 Indell Lane, Brampton Ontario L6T 3Y3
(905) 796-2650

Title:


ATTERBERG LIMITS CHART

File No.:

1-19-0720-01

APPENDIX C

TERRAPROBE INC.



CLIENT NAME: TERRAPROBE INC.
11 INDELL LANE
BRAMPTON, ON L6T3Y3
(905) 796-2650

ATTENTION TO: Jeff Au

PROJECT: 1840-1850 BLOOR ST CONDO

AGAT WORK ORDER: 19T555887

SOIL ANALYSIS REVIEWED BY: Yris Verastegui, Report Reviewer

DATE REPORTED: Dec 30, 2019

PAGES (INCLUDING COVER): 5

VERSION*: 1

Should you require any information regarding this analysis please contact your client services representative at (905) 712-5100

*NOTES

All samples will be disposed of within 30 days following analysis. Please contact the lab if you require additional sample storage time.



Certificate of Analysis

AGAT WORK ORDER: 19T555887

PROJECT: 1840-1850 BLOOR ST CONDO

5835 COOPERS AVENUE
MISSISSAUGA, ONTARIO
CANADA L4Z 1Y2
TEL (905)712-5100
FAX (905)712-5122
<http://www.agatlabs.com>

CLIENT NAME: TERRAPROBE INC.

ATTENTION TO: Jeff Au

SAMPLING SITE:

SAMPLED BY:

Corrosivity Package

DATE RECEIVED: 2019-12-13

DATE REPORTED: 2019-12-30

Parameter	Unit	SAMPLE DESCRIPTION:				
		BH2/SS6		BH6/SS5		BH8/SS6
		Soil		Soil		Soil
		2019-11-29		2019-11-28		2019-11-27
G / S	RDL	799225	799226	799227		
Chloride (2:1)	µg/g	2	117	36	6	
Sulphate (2:1)	µg/g	2	33	43	140	
pH (2:1)	pH Units	NA	8.13	8.16	8.17	
Electrical Conductivity (2:1)	mS/cm	0.005	0.328	0.225	0.266	
Resistivity (2:1) (Calculated)	ohm.cm	1	3050	4440	3760	
Redox Potential 1	mV	NA	273	350	344	
Redox Potential 2	mV	NA	273	353	314	
Redox Potential 3	mV	NA	270	352	303	

Comments: RDL - Reported Detection Limit; G / S - Guideline / Standard

799225-799227 EC, pH, Chloride and Sulphate were determined on the extract obtained from the 2:1 leaching procedure (2 parts DI water: 1 part soil). Resistivity is a calculated parameter. Redox potential measured on as received sample. Due to the potential for rapid change in sample equilibrium chemistry with exposure to oxidative/reduction conditions laboratory results may differ from field measured results.

Analysis performed at AGAT Toronto (unless marked by *)

Certified By:

Jris Veraestegui

Quality Assurance

 CLIENT NAME: TERRAPROBE INC.
 PROJECT: 1840-1850 BLOOR ST CONDO
 SAMPLING SITE:

 AGAT WORK ORDER: 19T555887
 ATTENTION TO: Jeff Au
 SAMPLED BY:

Soil Analysis															
RPT Date: Dec 30, 2019			DUPLICATE				Method Blank	REFERENCE MATERIAL			METHOD BLANK SPIKE		MATRIX SPIKE		
PARAMETER	Batch	Sample Id	Dup #1	Dup #2	RPD	Measured Value		Acceptable Limits		Recovery	Acceptable Limits		Recovery	Acceptable Limits	
								Lower	Upper		Lower	Upper		Lower	Upper

Corrosivity Package

Chloride (2:1)	797276		110	109	0.9%	< 2	98%	80%	120%	106%	80%	120%	98%	70%	130%
Sulphate (2:1)	797276		3430	3420	0.3%	< 2	104%	80%	120%	106%	80%	120%	101%	70%	130%
pH (2:1)	770878		7.88	7.90	0.3%	NA	101%	90%	110%	NA			NA		
Electrical Conductivity (2:1)	799262		0.104	0.105	1.0%	< 0.005	NA	90%	110%	NA			NA		

Comments: NA signifies Not Applicable.

 Duplicate Qualifier: As the measured result approaches the RL, the uncertainty associated with the value increases dramatically, thus duplicate acceptance limits apply only where the average of the two duplicates is greater than five times the RL
 pH duplicates QA acceptance criteria was met relative as stated in Table 5-15 of Analytical Protocol document.

Certified By:





Method Summary

CLIENT NAME: TERRAPROBE INC.

AGAT WORK ORDER: 19T555887

PROJECT: 1840-1850 BLOOR ST CONDO

ATTENTION TO: Jeff Au

SAMPLING SITE:

SAMPLED BY:

PARAMETER	AGAT S.O.P	LITERATURE REFERENCE	ANALYTICAL TECHNIQUE
Soil Analysis			
Chloride (2:1)	INOR-93-6004	McKeague 4.12 & SM 4110 B	ION CHROMATOGRAPH
Sulphate (2:1)	INOR-93-6004	McKeague 4.12 & SM 4110 B	ION CHROMATOGRAPH
pH (2:1)	INOR 93-6031	MSA part 3 & SM 4500-H+ B	PH METER
Electrical Conductivity (2:1)	INOR-93-6036	McKeague 4.12, SM 2510 B	EC METER
Resistivity (2:1) (Calculated)	INOR-93-6036	McKeague 4.12, SM 2510 B,SSA #5 Part 3	CALCULATION
Redox Potential 1	INOR-93-6066	G200-09, SM 2580 B	REDOX POTENTIAL ELECTRODE
Redox Potential 2	INOR-93-6066	G200-09, SM 2580 B	REDOX POTENTIAL ELECTRODE
Redox Potential 3	INOR-93-6066	G200-09, SM 2580 B	REDOX POTENTIAL ELECTRODE



AGAT Laboratories

18AS

5835 Coopers Avenue
Mississauga, Ontario L4Z 1Y2
Ph: 905.712.5100 Fax: 905.712.5122
webearth.agatlabs.com

Laboratory Use Only

Work Order #: 19T555887

Cooler Quantity: _____
Arrival Temperatures: 6.4 | 6.5 | 6.5
6.3 | 6.4 | 6.4

Custody Seal Intact: Yes No N/A
Notes: _____

Chain of Custody Record

If this is a Drinking Water sample, please use Drinking Water Chain of Custody Form (potable water consumed by humans)

Report Information:

Company: Terraprobe
Contact: Jeff Au
Address: 11 Indell Lane
Brampton, ONT
905.796.2650 X171 Fax: _____
Reports to be sent to:
1. Email: jauc@terraprobe.ca
2. Email: _____

Regulatory Requirements:

No Regulatory Requirement
(Please check all applicable boxes)

Regulation 153/04 Sewer Use Regulation 558
 Ind/Com Sanitary CCME
 Res/Park Storm Prov. Water Quality Objectives (PWQO)
 Agriculture Other
Soil Texture (Check One) Region: _____
 Coarse MISA Fine _____
Indicate One

Project Information:

Project: 1840-1850 Bloor St Condo
Site Location: 1840 Bloor St, Mississauga
Sampled By: Dhruvish
AGAT Quote #: _____ PO: 1-19-0720-01
Please note: If quotation number is not provided, client will be billed full price for analysis.

Is this submission for a Record of Site Condition?

Yes No

Report Guideline on Certificate of Analysis

Yes No

Invoice Information:

Company: _____
Contact: _____
Address: _____
Email: _____
Bill To Same: Yes No

Sample Matrix Legend

B Biota
GW Ground Water
O Oil
P Paint
S Soil
SD Sediment
SW Surface Water

Field Filtered - Metals, Hg, CrVI

O. Reg 153

Metals and Inorganics
 All Metals 153 Metals (excl. Hydrides)
 Hydride Metals 153 Metals (incl. Hydrides)
ORPs: B-HWS Cl ON
 Cr* EC FOC Hg
 pH SAR
Full Metals Scan
Regulation/Custom Metals
Nutrients: TP NH₃ TKN
 NO₃ NO₂ NO_x+NO₂
Volatiles: VOC BTEX THM
PHCs F1 - F4
ABNS
PAHS
PCBs: Total Aroclor's
Organochlorine Pesticides
TCLP: M&I VOCs ABNS B(a)P PCBs
Sewer Use
Corrosivity package

Sample Identification	Date Sampled	Time Sampled	# of Containers	Sample Matrix	Comments/ Special Instructions	Y / N	Metals and Inorganics	ORPs	Nutrients	Volatiles	PHCs F1 - F4	ABNS	PAHS	PCBs	Organochlorine Pesticides	TCLP	Sewer Use	Potentially Hazardous or High Concentration (Y/N)	
BH2/SS6	11/29/19		1	Soil	Soil													X	
BH6/SS5	11/28/19		1	Soil	Soil													X	
BH8/SS6	11/29/19		1	Soil	Soil													X	
BH2/SS6																			

Samples Relinquished By (Print Name and Sign): <u>Jeff Au</u>	Date: <u>12/13/19</u>	Time: _____	Samples Received By (Print Name and Sign): <u>[Signature]</u>	Date: <u>2019/12/13</u>	Time: <u>5:05</u>	Samples Relinquished By (Print Name and Sign): _____	Date: _____	Time: _____	Samples Received By (Print Name and Sign): _____	Date: _____	Time: _____	Page _____ of _____
Samples Relinquished By (Print Name and Sign): _____	Date: _____	Time: _____	Samples Received By (Print Name and Sign): _____	Date: _____	Time: _____	Samples Relinquished By (Print Name and Sign): _____	Date: _____	Time: _____	Samples Received By (Print Name and Sign): _____	Date: _____	Time: _____	No: T 095890



CLIENT NAME: TERRAPROBE INC.
11 INDELL LANE
BRAMPTON, ON L6T3Y3
(905) 796-2650

ATTENTION TO: Jeff Au

PROJECT: 19T555887

AGAT WORK ORDER: 19T557316

SOLID ANALYSIS REVIEWED BY: Jing Xiao, Data Reviewer

DATE REPORTED: Dec 30, 2019

PAGES (INCLUDING COVER): 5

Should you require any information regarding this analysis please contact your client services representative at (905) 501-9998

*NOTES

All samples are stored at no charge for 90 days. Please contact the lab if you require additional sample storage time.



Certificate of Analysis

AGAT WORK ORDER: 19T557316

PROJECT: 19T555887

5623 McADAM ROAD
MISSISSAUGA, ONTARIO
CANADA L4Z 1N9
TEL (905)501-9998
FAX (905)501-0589
<http://www.agatlabs.com>

CLIENT NAME: TERRAPROBE INC.

ATTENTION TO: Jeff Au

(201-042) Sulfide

DATE SAMPLED: Dec 17, 2019	DATE RECEIVED: Dec 18, 2019	DATE REPORTED: Dec 30, 2019	SAMPLE TYPE: Other
----------------------------	-----------------------------	-----------------------------	--------------------

Analyte:	Sulfide
Unit:	%
Sample ID (AGAT ID)	RDL: 0.05
BH2/SS6 (811970)	<0.05
BH6/SS5 (811971)	<0.05
BH8/SS6 (811972)	0.17

Comments: RDL - Reported Detection Limit
Analysis performed at AGAT Toronto (unless marked by *)

Certified By:



CLIENT NAME: TERRAPROBE INC.

ATTENTION TO: Jeff Au

(201-042) Sulfide

Parameter	REPLICATE #1				REPLICATE #2											
	Sample ID	Original	Replicate	RPD	Sample ID	Original	Replicate	RPD								
S	811970	0.027	0.019	34.8%	811972	0.167	0.172	2.9%								
Sulfate	811970	< 0.01	<0.01	0.0%	811972	< 0.01	<0.01	0.0%								
Sulfide	811970	< 0.05	<0.05	0.0%	811972	0.17	0.17	0.0%								



CLIENT NAME: TERRAPROBE INC.

ATTENTION TO: Jeff Au

(201-042) Sulfide

Parameter	CRM #1				CRM #2											
	Expect	Actual	Recovery	Limits	Expect	Actual	Recovery	Limits								
S	0.80	0.79	98%	90% - 110%	0.80	0.79	98%	90% - 110%								
Sulfate	0.01	0.01	100%	90% - 110%	0.01	0.01	100%	90% - 110%								
Sulfide	0.80	0.78	97%	90% - 110%	0.80	0.78	97%	90% - 110%								



Method Summary

CLIENT NAME: TERRAPROBE INC.

AGAT WORK ORDER: 19T557316

PROJECT: 19T555887

ATTENTION TO: Jeff Au


SAMPLING SITE:



SAMPLED BY:

PARAMETER	AGAT S.O.P	LITERATURE REFERENCE	ANALYTICAL TECHNIQUE
Solid Analysis			
Sulfide	MIN-200-12037		LECO

APPENDIX D

TERRAPROBE INC.



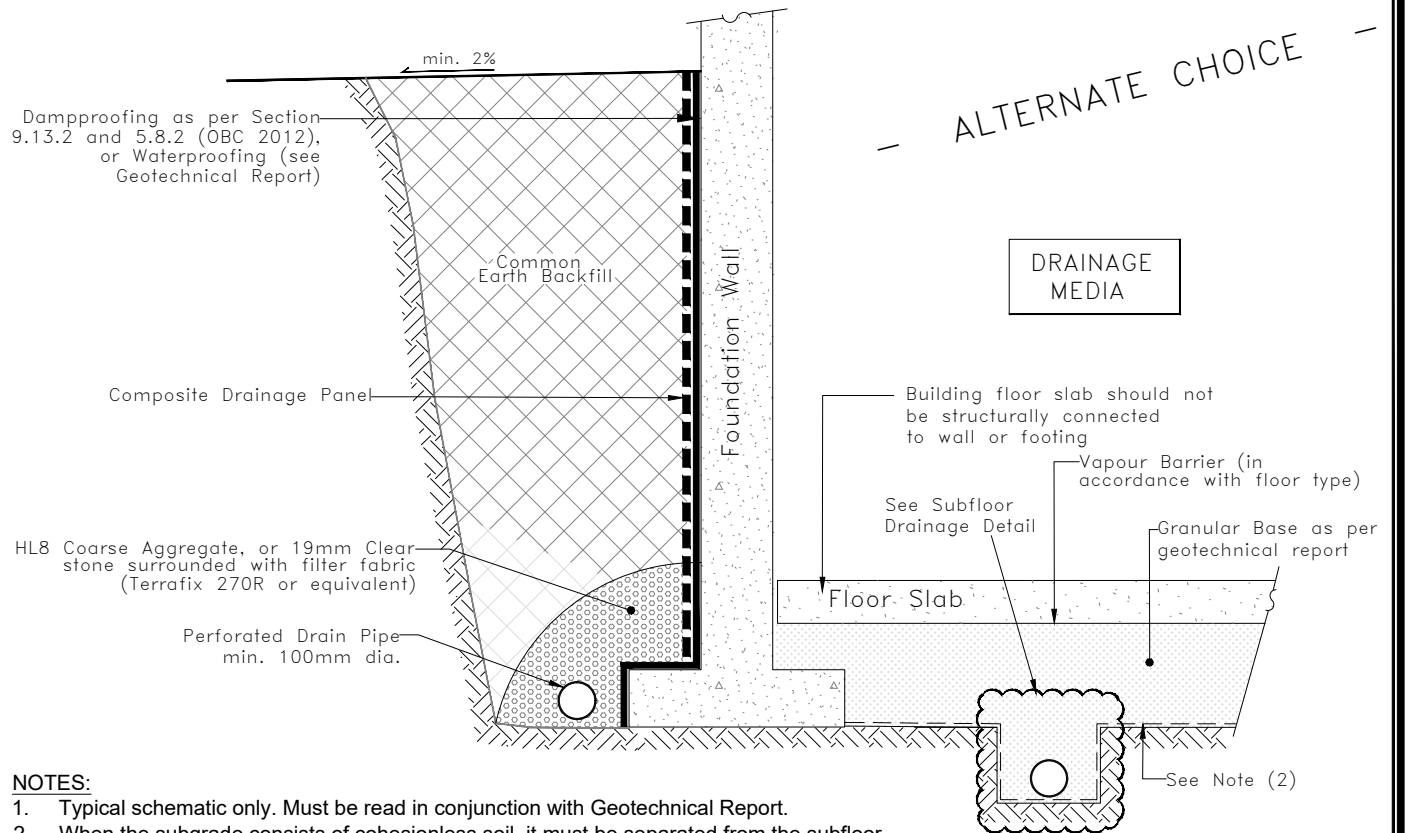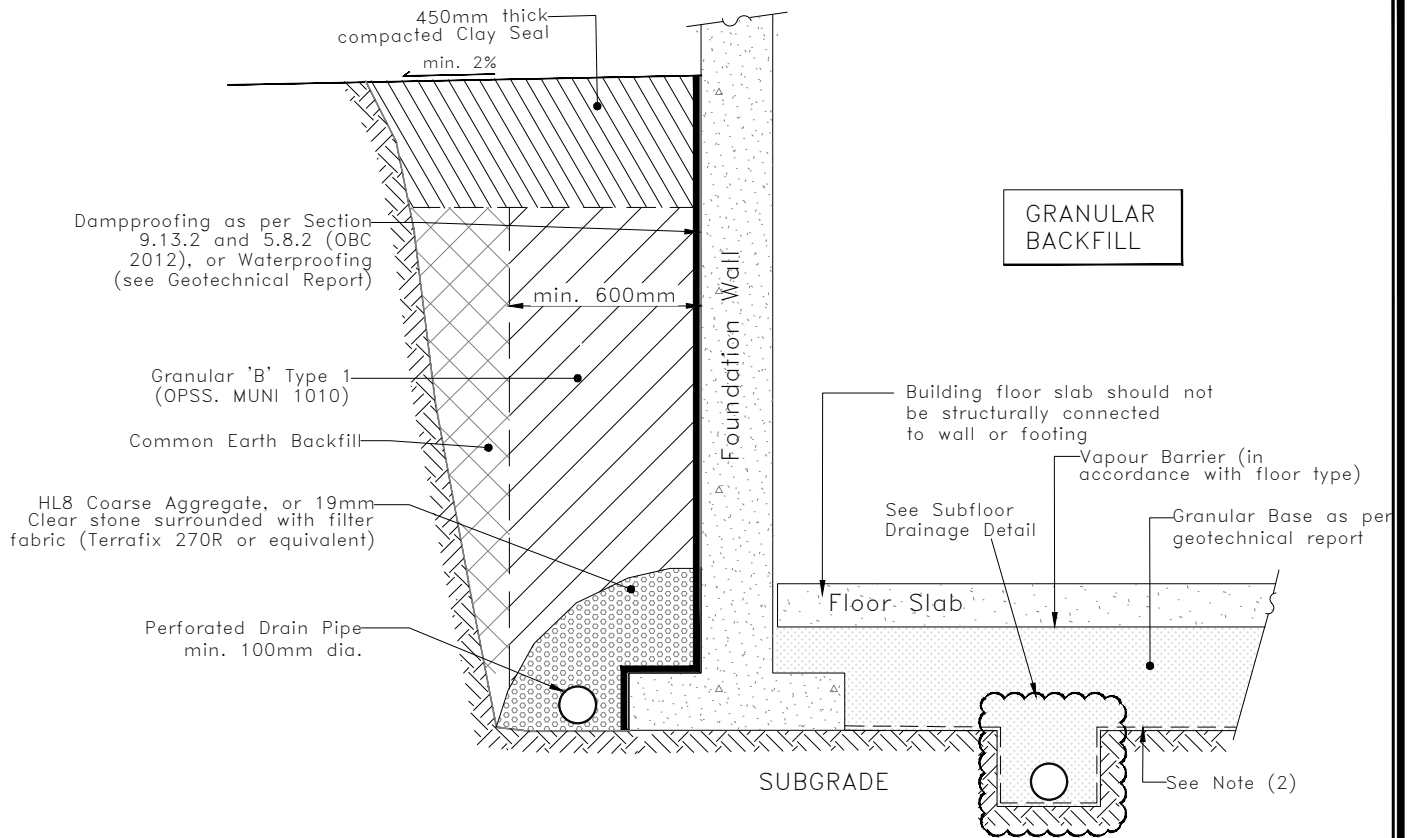


NOTES:

1. Typical schematic only. Must be read in conjunction with Geotechnical Report.
2. When the subgrade consists of cohesionless soil, it must be separated from the subfloor drainage layer using a non-woven geotextile (Terrafix 360R or approved equivalent).
3. Not to Scale

Title:

**TYPICAL BASEMENT DRAINAGE SCHEMATIC
(OPEN EXCAVATION)**

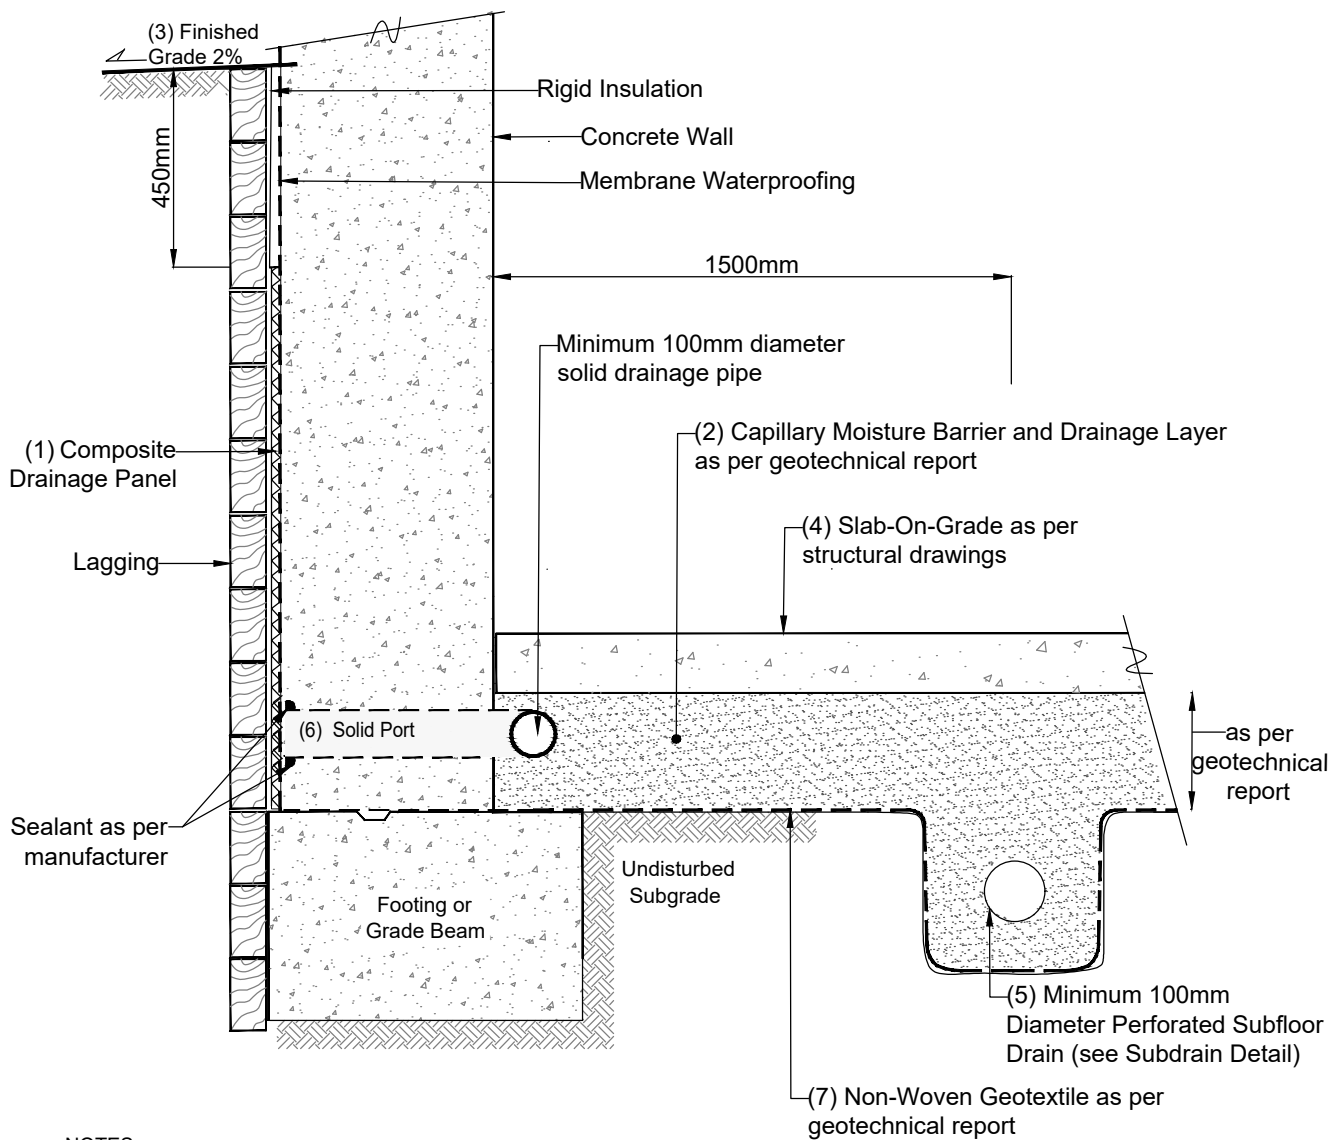

NOTES

- 1) Prefabricated composite drainage panels to consist of Miradrain 6000, or approved equivalent. Panels should provide continuous cover as per manufacturer's requirements.
- 2) Capillary moisture barrier/drainage layer to consist of a minimum 200mm layer of 19mm clear stone (OPSS. MUNI 1004), or as indicated in geotechnical report, compacted to a dense state. Upper 50mm can be replaced with Granular "A" (OPSS. MUNI 1010) compacted to 98% SPMDD where vehicular traffic is required. A vapour barrier may be required depending on floor type.
- 3) Exterior finished grade away from wall at a minimum grade of 2% for min. 1.2m.
- 4) Building floor slab-on-grade shall not be structurally connected to foundation wall or footing.
- 5) Subfloor drain invert to be a minimum of 300mm below underside of floor slab, to be set in parallel rows, one way, and at the spacing specified in the geotechnical report. Don't connect subfloor drains to perimeter drains.
- 6) Embedded ports to be set a distance of maximum 3m on-centre. Each port to have a minimum cross-sectional area of 1500mm². Perimeter drainage must be collected and conveyed directly to the building sumps in solidpipe.
- 7) When the subgrade consists of a cohesionless soil, the subgrade must be separated from the subfloor drainage layer using a non-woven geotextile (Terrafix 360R or approved equivalent).
- 8) Geotechnical report contains specific details. Final detail must be reviewed before system is considered acceptable to use.

N.T.S.




Terraprobe

11 Indell Lane, Brampton, Ontario, L6T 3Y3
Tel: (905) 796-2650 Fax: (905) 796-2250

Title:

**SCHEMATIC DRAINAGE DETAIL
SOLDIER PILE & LAGGING SHORING SYSTEM
(ONE-SIDED WALL CONSTRUCTION)**

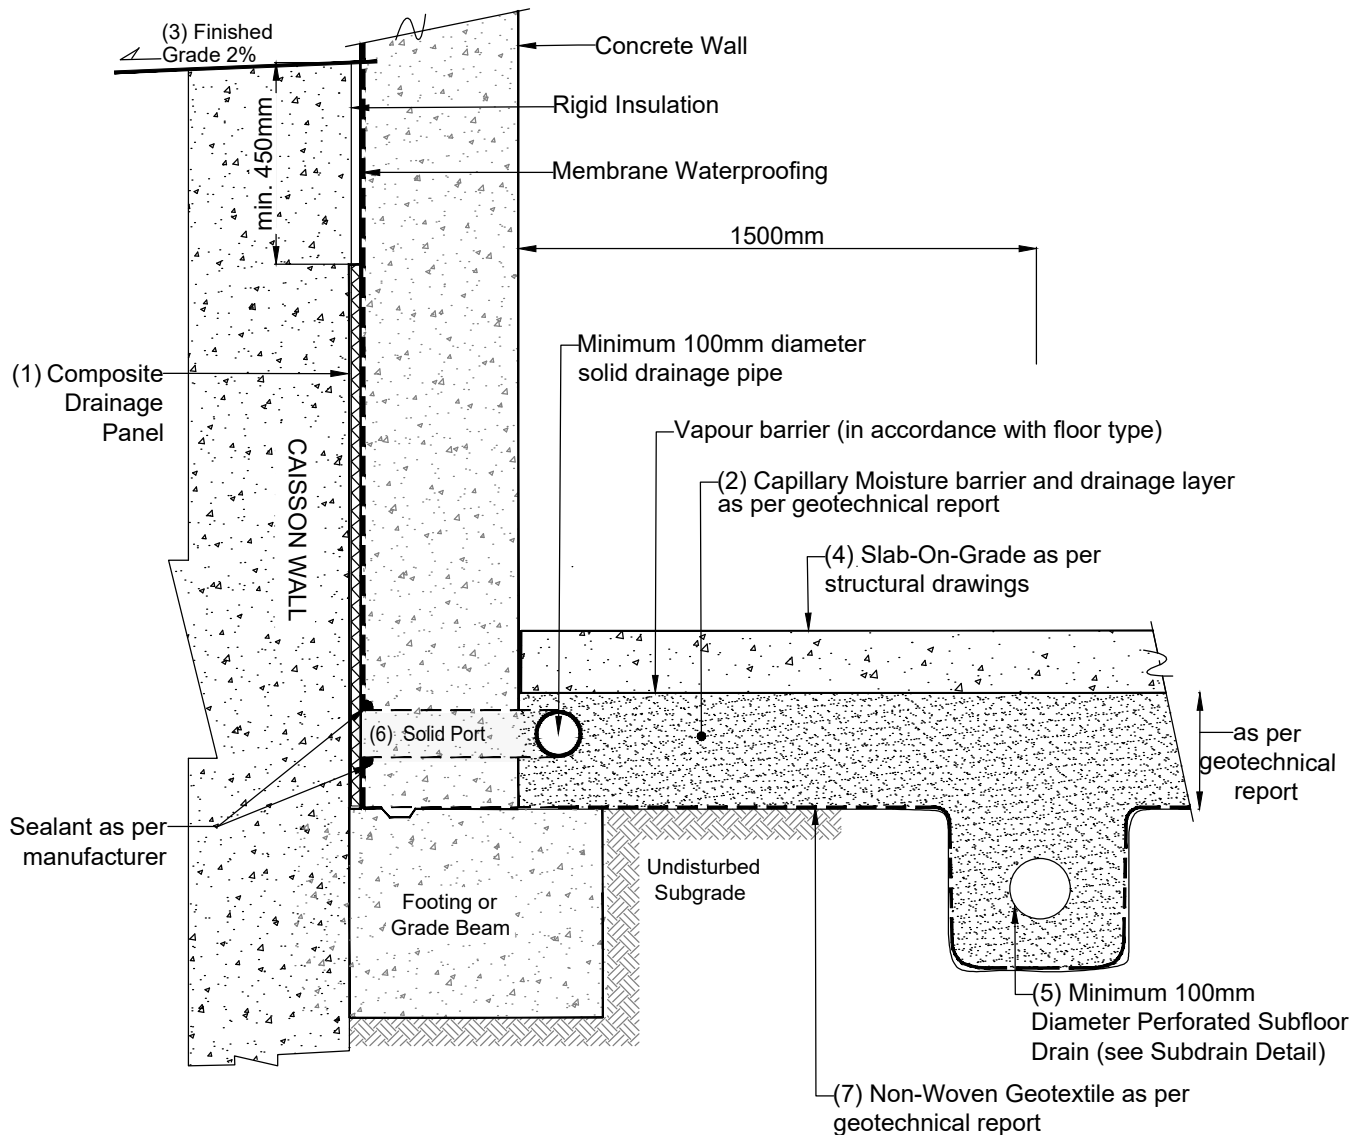

NOTES

- 1) Prefabricated composite drainage panels to consist of Miradrain 6000, or approved equivalent. Panels should provide continuous cover as per manufacturer's requirements.
- 2) Capillary moisture barrier/drainage layer to consist of a minimum 200mm layer of 19mm clear stone (OPSS. MUNI 1004), or as indicated in geotechnical report, compacted to a dense state. Upper 50mm can be replaced with Granular "A" (OPSS. MUNI 1010) compacted to 98% SPMD where vehicular traffic is required. A vapour barrier may be required depending on floor type.
- 3) Exterior finished grade away from wall at a minimum grade of 2% for min. 1.2m.
- 4) Building floor slab-on-grade shall not be structurally connected to foundation wall or footing.
- 5) Subfloor drain invert to be a minimum of 300mm below underside of floor slab, to be set in parallel rows, one way, and at the spacing specified in the geotechnical report. Don't connect subfloor drains to perimeter drains.
- 6) Embedded ports to be set a distance of maximum 3m on-centre. Each port to have a minimum cross-sectional area of 1500mm². Perimeter drainage must be collected and conveyed directly to the building sumps in solidpipe.
- 7) When the subgrade consists of a cohesionless soil, the subgrade must be separated from the subfloor drainage layer using a non-woven geotextile (Terrafix 360R or approved equivalent).
- 8) Geotechnical report contains specific details. Final detail must be reviewed before system is considered acceptable to use.

N.T.S




Terraprobe

11 Indell Lane, Brampton, Ontario, L6T 3Y3
Tel: (905) 796-2650 Fax: (905) 796-2250

Title:

**SCHEMATIC BASEMENT DRAINAGE DETAIL
CAISSON WALL SHORING SYSTEM
(ONE-SIDED WALL CONSTRUCTION)**

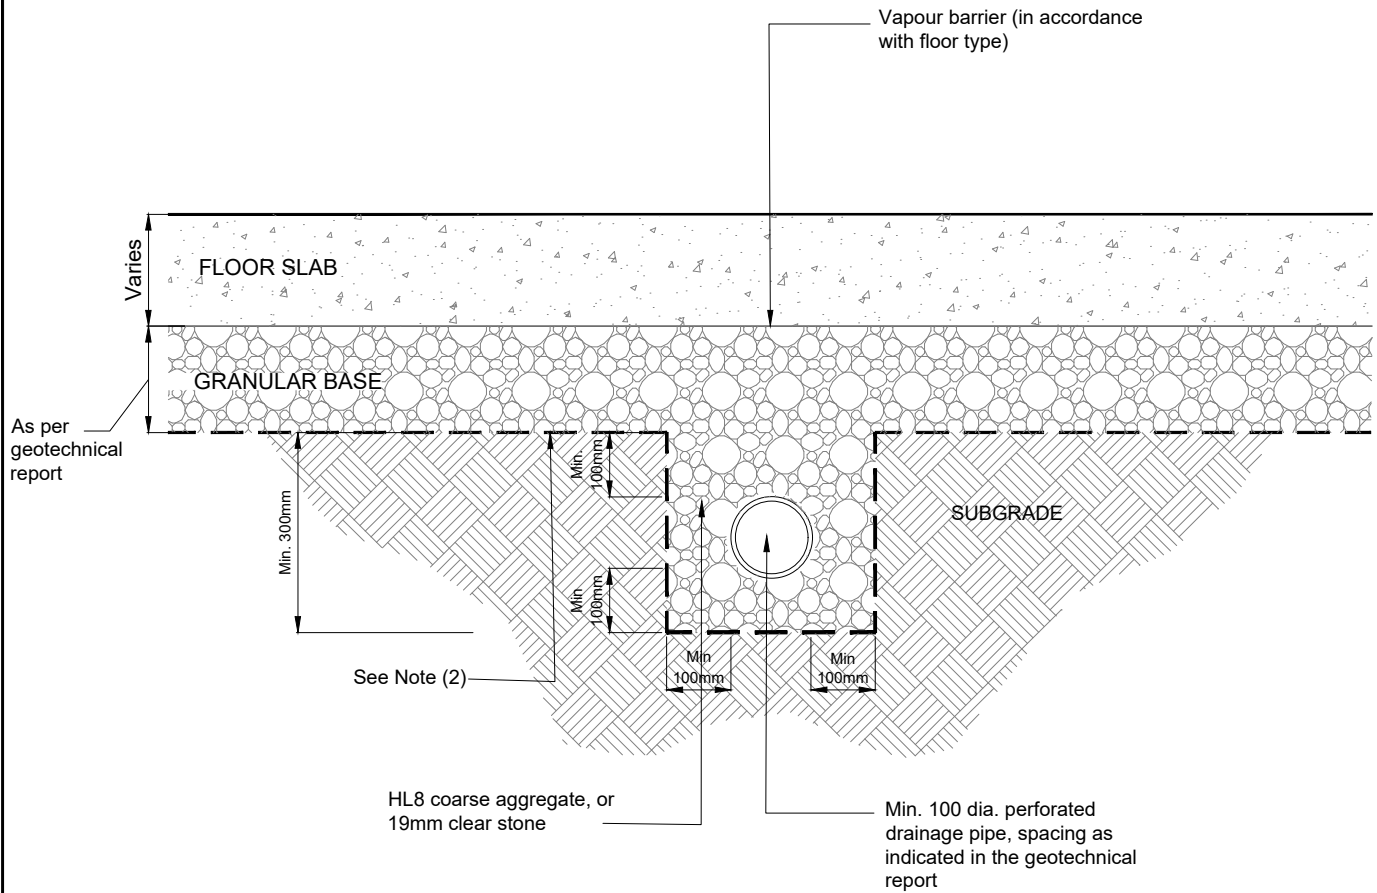

NOTES:

1. Typical schematic only. Must be read in conjunction with Geotechnical Report.
2. When the subgrade consists of cohesionless soil, it must be separated from the subfloor drainage layer using a non-woven geotextile (Terrafix 360R or approved equivalent).
3. Not to Scale



Terraprobe

11 Indell Lane, Brampton, Ontario, L6T 3Y3
Tel: (905) 796-2650 Fax: (905) 796-2250

Title:

TYPICAL BASEMENT SUBDRAIN DETAIL