



METRIC

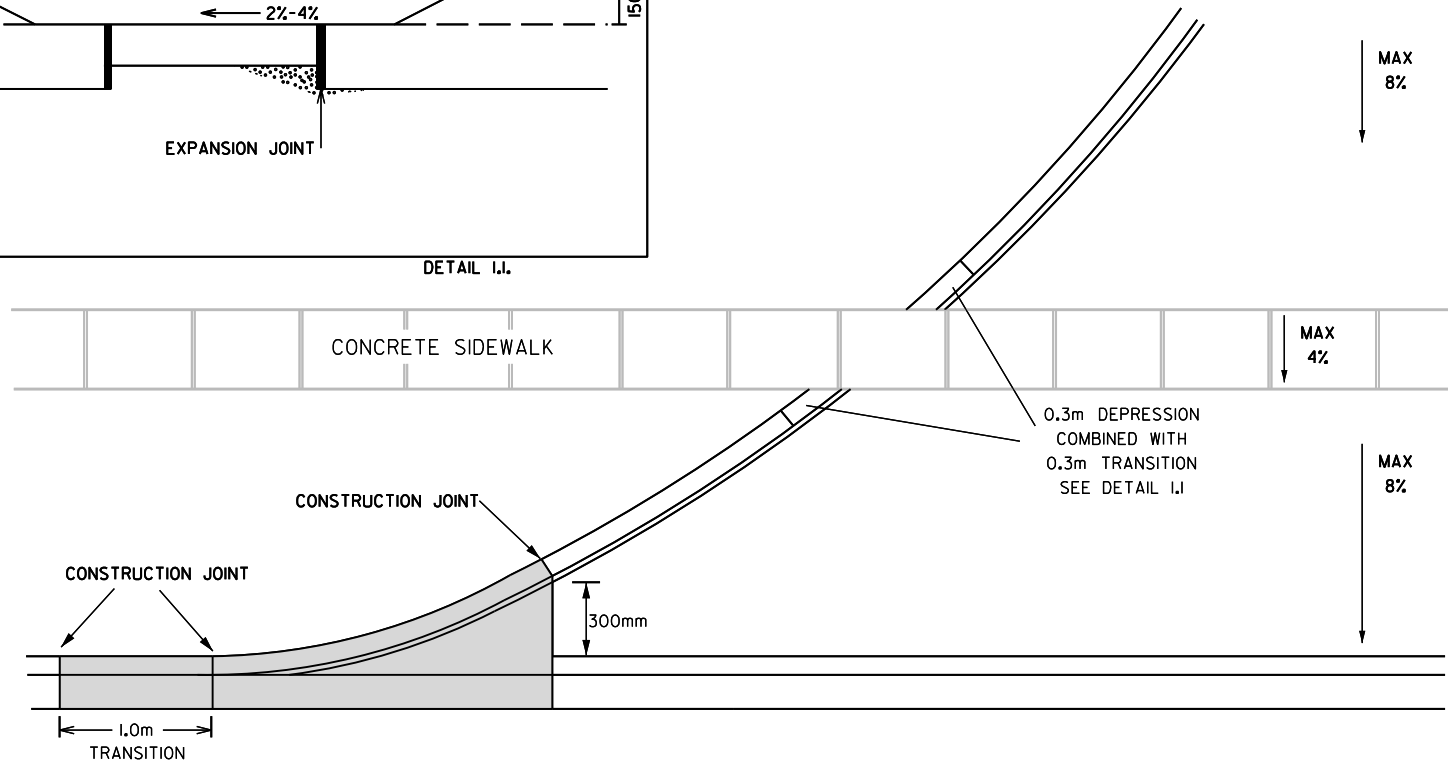

NOTES

1. WHERE SIDEWALK IS IN BOULEVARD, THE CONSTRUCTION JOINT SHALL BE BETWEEN SIDEWALK AND STREET CURB.
2. CONSTRUCTION JOINTS ON STREET CURB SHALL BE 1.0m FROM MATCH OF FACE OF CURBS.
3. FULL DEPTH EXPANSION JOINT MATERIAL REQUIRED AT ALL CONSTRUCTION JOINTS.
4. CONCRETE SHALL BE CSA C-2, OR C-2 HIGH EARLY.
5. DISTANCE FROM BACK OF STREET CURB IN FLAT AREA TO FRONT EDGE OF DRIVEWAY CURB SHALL BE 300mm.
6. SHADED AREA TO BE POURED MONOLITHICALLY.
7. HEAVY DUTY CURB DETAIL REFERENCE STANDARD 2230.020.

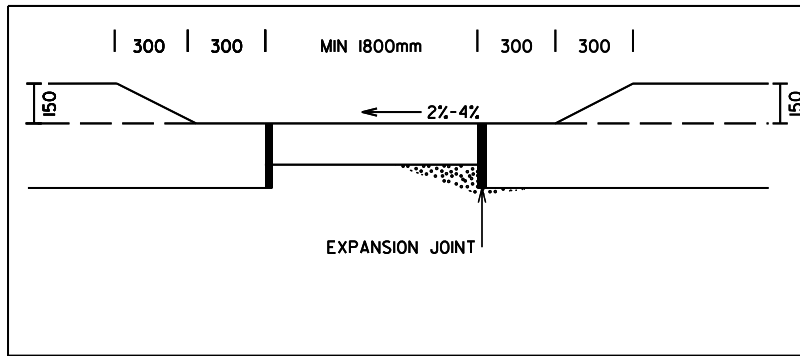

COMMERCIAL INDUSTRIAL
DRIVEWAY CURB RETURNS
AT STREET CURB

| | | | |
|---------------------|---|------------|-----------------------|
| EFF. DATE: DEC 2015 | | SCALE | N.T.S. |
| REV. | 1 | APRIL 2017 | STANDARD No. 2240.031 |