


# MCS ELECTRICAL MAP

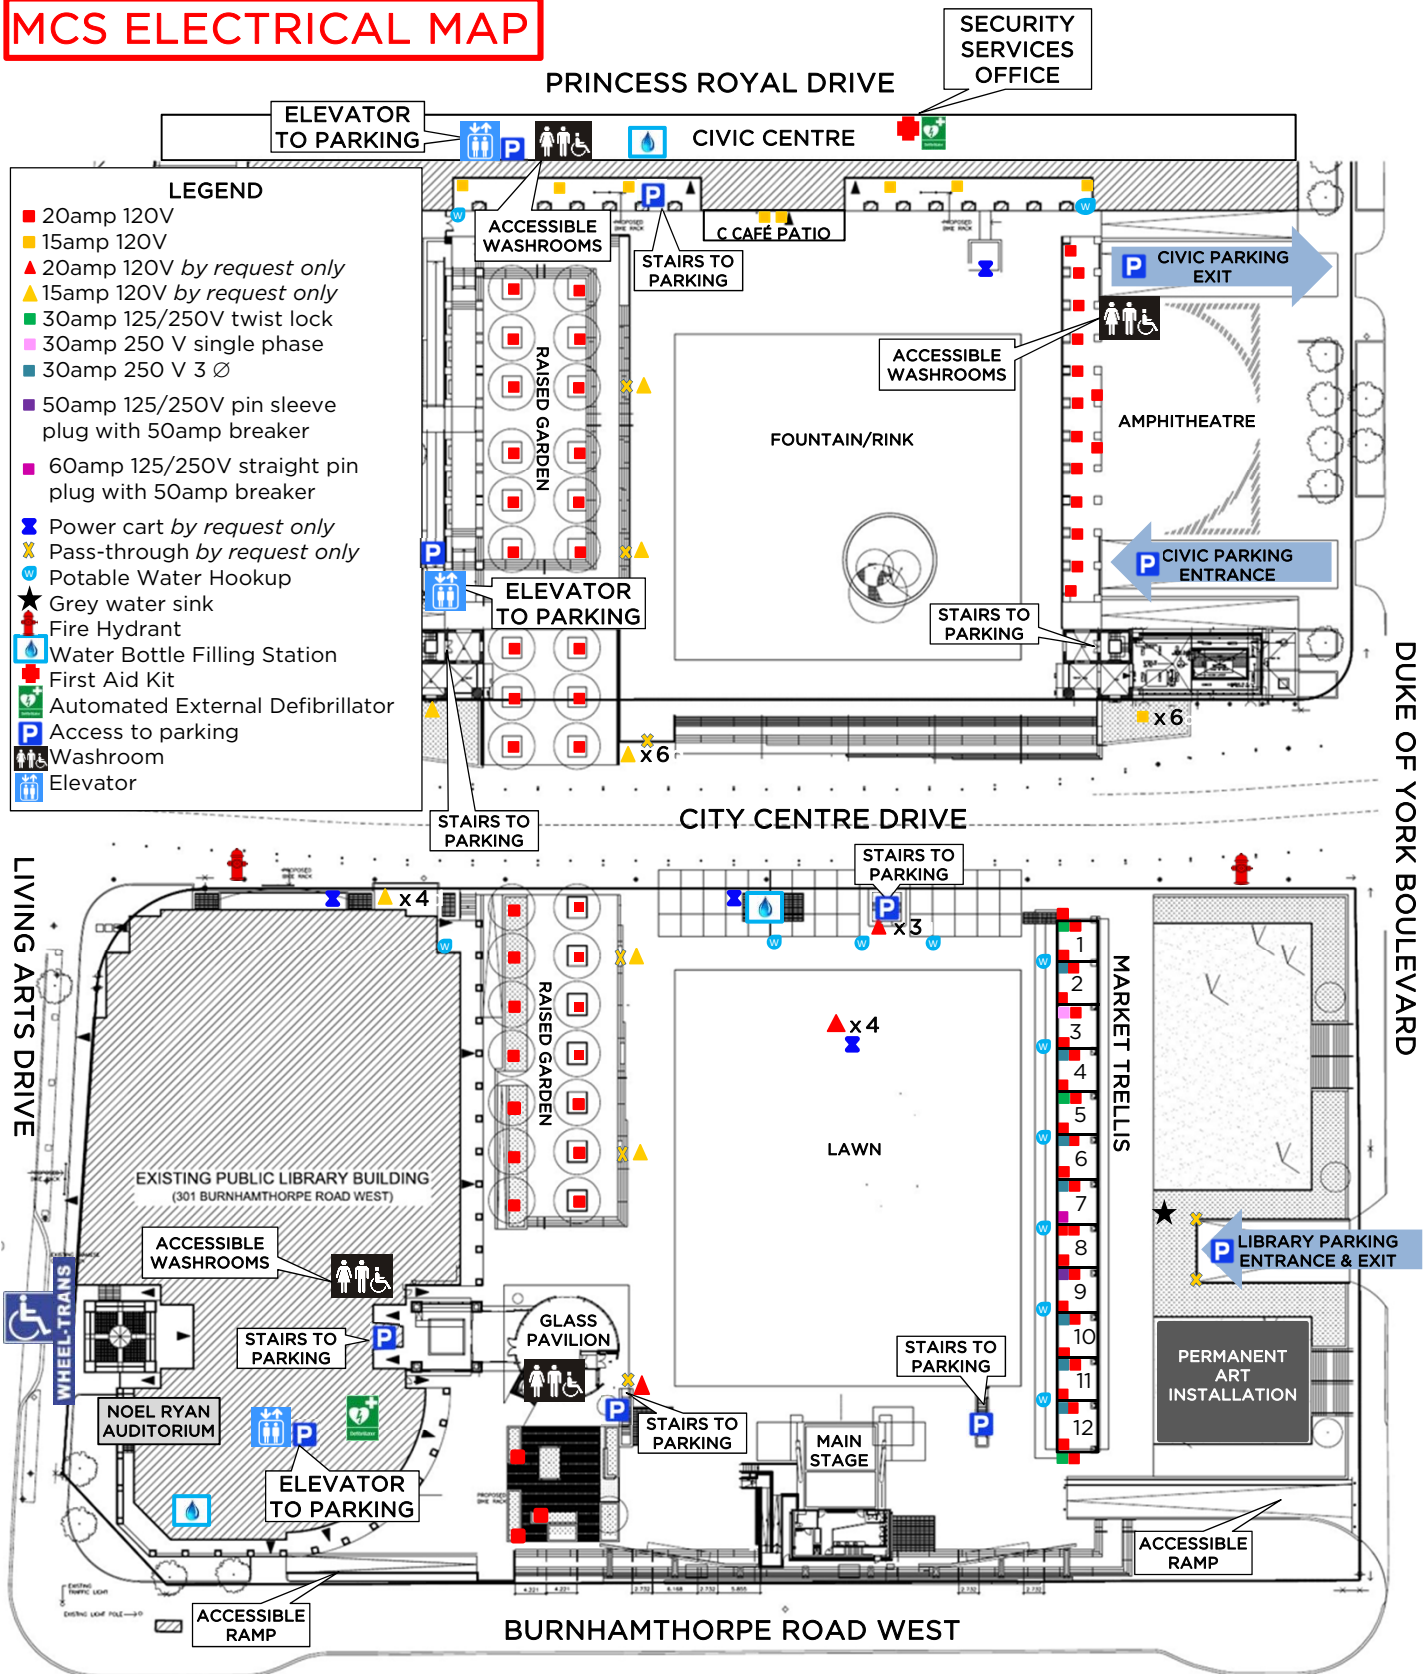

- Each Market Trellis bay has two 20amp 120V circuits; one on either side of the bay
  - Market Trellis Bays #1, #5 & #12: 30amp 125/250V circuits (in addition to 20amp circuit on both sides of each pillar)
  - Market Trellis Bay #9: 50amp 125/250V pin sleeve plug protected by 50amp breaker (in addition to 20amp circuit on both sides of each pillar)
  - Market Trellis Bay #7: 60amp 120/250V straight pin plug protected by 50amp breaker (in addition to 20amp circuit on both sides of each pillar)
  - Market Trellis Bay #3: 30amp 250V single phase circuit (in addition to 20amp circuit on both sides of each pillar)
  - A power cart is available in two (2) of four (4) locations *if requested in advance*: 20amp 120V power with 20 circuits
  - Each vendor must supply their own 100' extension cords rated for outdoor use in safe working condition
- If electrical requirements exceed what is available on this map, a private electrical contractor may be arranged by the organizer at the organizer's expense to run cabling, lay cable mats and plug into distribution panels.**